



ENERGY STAR Certified Homes, Version 3 (Rev. 07)

County-Level Reference Design: Climate Zone 5¹

Certifying Homes

The following homes are eligible to earn the ENERGY STAR:

- Detached dwelling units² (e.g. single family homes); OR
- Dwelling units² in any multifamily building with 4 units or fewer; OR
- Dwelling units² in multifamily buildings with 3 stories or fewer above-grade^{3,4}; OR
- Dwelling units² in multifamily buildings with 4 or 5 stories above-grade^{3,4} that have their own heating, cooling, and hot water systems⁵, separate from other units, and where dwelling units occupy 80% or more of the occupiable⁴ square footage of the building⁶. When evaluating mixed-use buildings for eligibility, exclude commercial / retail space when assessing whether the 80% threshold has been met.

Dwelling units² in multifamily buildings that are not eligible to earn the ENERGY STAR through the Certified Homes Program may be eligible through the Multifamily High Rise Program.

Homes may earn the ENERGY STAR using the following ENERGY STAR Prescriptive Path in all locations except CA, FL, GU, HI, MA, PR, and the Pacific Northwest, for which regional program requirements have been developed.

Note that compliance with these guidelines is not intended to imply compliance with all local code requirements that may be applicable to the home to be built.⁷

ENERGY STAR Prescriptive Path

The Prescriptive Path provides a single set of measures that can be used to construct an ENERGY STAR certified home. Modeling is not required; however, no tradeoffs are allowed. Follow these steps to use the Prescriptive Path:

1. First, assess the eligibility to follow the Prescriptive Path by comparing the conditioned floor area (CFA) of the home to be built to the CFA of the Benchmark Home as specified in Exhibit 2.⁸ For the purposes of this step, calculate the number of bedrooms and the CFA of the home to be built using RESNET standards with the following exception: floor area in basements with at least half of the gross surface area of the basement's exterior walls below grade shall not be counted.⁹ If the CFA of the home to be built exceeds the CFA of the Benchmark Home, then the Performance Path shall be used. See www.energystar.gov/newhomesguidelines for more information on the Performance Path.
2. If the home to be built is eligible to follow the Prescriptive Path, build the home using all requirements of the ENERGY STAR Reference Design, Exhibit 3, and the Mandatory Requirements for All Certified Homes, Exhibit 1.
3. Using a Rater, verify that all requirements have been met in accordance with the Mandatory Requirements for All Certified Homes and with RESNET's On-Site Inspection Procedures for Minimum Rated Features.¹⁰

Partnership, Training, and Credentialing Requirements

Builders, Raters, and HVAC contractors must meet the following requirements prior to certifying homes under these guidelines:

- Builders are required to be ENERGY STAR partners and complete the online Version 3 Builder Orientation. Partnership Agreements and Version 3 Builder Orientation can be found at www.energystar.gov/homesPA.
- HVAC contractors must be credentialed by an EPA-recognized HVAC Quality Installation Training and Oversight Organization (H-QUITO). An explanation of this process and links to H-QUITOs can be found at www.energystar.gov/newhomesHVAC.
- Raters and Field Inspectors are required to complete Version 3 Training which can be found at www.energystar.gov/newhomestraining.

Exhibit 1: Mandatory Requirements for All Certified Homes

Area of Improvement	Mandatory Requirements
1. Thermal Enclosure System	• Completed Thermal Enclosure System Rater Checklist
2. Heating, Ventilation, & Air Conditioning (HVAC) System	• Completed HVAC System Quality Installation Contractor Checklist • Completed HVAC System Quality Installation Rater Checklist
3. Water Management System	• Completed Water Management System Builder Checklist

Exhibit 2: Benchmark Home⁸

Bedrooms in Home to be Built	0	1	2	3	4	5	6	7	8
Conditioned Floor Area Benchmark Home	1,000	1,000	1,600	2,200	2,800	3,400	4,000	4,600	5,200

Checklist Instructions

The Rater must review all items in this county-level reference design checklist. The column titled "N/A," which denotes items that are "not applicable," should be used when the checklist item is not present in the home or conflicts with local requirements. In the event that a Rater finds an item that is inconsistent with this county-level reference design, the home cannot earn the ENERGY STAR until the item is corrected. If correction of the item is not possible, the home cannot earn the ENERGY STAR. In the event that an item cannot be inspected by the Rater, the home also cannot earn the ENERGY STAR.



ENERGY STAR Certified Homes, Version 3 (Rev. 07)

County-Level Reference Design: Climate Zone 5¹

Exhibit 3: ENERGY STAR Reference Design

Home Address: _____		City: _____		State: _____																													
System	Inspection Guidelines	Rater Verified	Must Correct	NA																													
Benchmark Home Size	Home Size (ft ²) ≤ Benchmark Home Size (ft ²) # BR: _____ Home Size (ft ²): _____ Benchmark Home Size (ft ²): _____	<input type="checkbox"/>	-	-																													
Cooling Equipment ¹²	Cooling equipment, where provided, meets one of the options below (check one): <input type="checkbox"/> ≥ 13 SEER A/C <input type="checkbox"/> Heat pump (See Heating Equipment)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>																													
Heating Equipment ¹²	Heating equipment meets one of the options below (check one): <input type="checkbox"/> ≥ 90 AFUE gas furnace <input type="checkbox"/> ≥ 85 AFUE oil furnace, ENERGY STAR certified <input type="checkbox"/> ≥ 85 AFUE boiler, ENERGY STAR certified <input type="checkbox"/> ≥ 9.25 HSPF / 14.5 SEER / 12 EER ENERGY STAR certified air-source heat pump with electric backup ¹³ <input type="checkbox"/> ≥ 8.2 HSPF / 14.5 SEER / 12 EER ENERGY STAR certified air-source heat pump with ENERGY STAR certified dual-fuel backup <input type="checkbox"/> Ground source heat pump, any product type, ENERGY STAR certified ¹⁴	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>																													
Envelope ¹⁵	Infiltration rate ≤ 4 ACH50 Insulation achieves Grade I installation per RESNET standards. ¹⁶ Ceiling insulation ≥ 38 R-Value ¹⁷ Wall insulation ≥ 20 R-Value ¹⁷ Floor insulation over unconditioned space ≥ 30 R-Value ¹⁷ Slab insulation ≥ 10 R-Value; Depth ≥ 2 ft ^{17,18} Crawlspace wall insulation for unvented crawlspaces meets one of two options (check one): ¹⁷ <input type="checkbox"/> ≥ 10 R-Value Continuous <input type="checkbox"/> ≥ 13 R-Value Framed Wall Basement wall insulation next to conditioned space meets one of two options (check one): ¹⁷ <input type="checkbox"/> ≥ 10 R-Value Continuous <input type="checkbox"/> ≥ 13 R-Value Framed Wall	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>																													
Windows & Doors ^{19,20}	Windows: ≤ 0.30 U-Value; Any SHGC Skylights: ≤ 0.55 U-Value; Any SHGC If total window-to-floor area ≥ 15%, then U-values or SHGCs adjusted as outlined in Footnote 20. Door U-Value: Opaque: ≤ 0.21 ≤½ lite: ≤ 0.27 >½ lite: ≤ 0.32 Door SHGC: Opaque: No Rating ≤½ lite: ≤ 0.30 >½ lite: ≤ 0.30	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>																													
Water Heater	Energy Factor (EF) meets the requirements based upon fuel type and tank size. ²¹ <table border="1"> <tr> <td>Tank Size:</td> <td>30 Gallon</td> <td>40 Gallon</td> <td>50 Gallon</td> <td>60 Gallon</td> <td>70 Gallon</td> <td>80 Gallon</td> </tr> <tr> <td>Gas:</td> <td>0.63 EF</td> <td>0.61 EF</td> <td>0.59 EF</td> <td>0.57 EF</td> <td>0.55 EF</td> <td>0.53 EF</td> </tr> <tr> <td>Electric:</td> <td>0.94 EF</td> <td>0.93 EF</td> <td>0.92 EF</td> <td>0.91 EF</td> <td>0.90 EF</td> <td>0.89 EF</td> </tr> <tr> <td>Oil:</td> <td>0.55 EF</td> <td>0.53 EF</td> <td>0.51 EF</td> <td>0.49 EF</td> <td>0.47 EF</td> <td>0.45 EF</td> </tr> </table>	Tank Size:	30 Gallon	40 Gallon	50 Gallon	60 Gallon	70 Gallon	80 Gallon	Gas:	0.63 EF	0.61 EF	0.59 EF	0.57 EF	0.55 EF	0.53 EF	Electric:	0.94 EF	0.93 EF	0.92 EF	0.91 EF	0.90 EF	0.89 EF	Oil:	0.55 EF	0.53 EF	0.51 EF	0.49 EF	0.47 EF	0.45 EF	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
Tank Size:	30 Gallon	40 Gallon	50 Gallon	60 Gallon	70 Gallon	80 Gallon																											
Gas:	0.63 EF	0.61 EF	0.59 EF	0.57 EF	0.55 EF	0.53 EF																											
Electric:	0.94 EF	0.93 EF	0.92 EF	0.91 EF	0.90 EF	0.89 EF																											
Oil:	0.55 EF	0.53 EF	0.51 EF	0.49 EF	0.47 EF	0.45 EF																											
Thermostat & Ductwork	Programmable thermostat installed unless thermostat controls a zone with electric radiant heat, for which a manual thermostat is allowed. ²² Supply ducts in unconditioned attic ≥ R-8; All others in unconditioned space ≥ R-6 Total duct leakage ≤ 8 CFM25 per 100 sq. ft. of CFA. ²³ Duct leakage to outdoors ≤ 4 CFM25 per 100 sq. ft. of CFA. ^{23, 24}	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>																													
Lighting & Appliances	ENERGY STAR certified refrigerators, dishwashers, ceiling fans, exhaust fans. ²⁵ ENERGY STAR certified light bulbs or fixtures shall be installed in 80% of RESNET-defined Qualifying Light Fixture Locations. ²⁶	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>																													




ENERGY STAR Certified Homes, Version 3 (Rev. 07)

County-Level Reference Design Notes

Notes:

1. The following map is shown to depict Climate Zone boundaries. It is for illustrative purposes only and is based on 2009 IECC Figure 301.1.

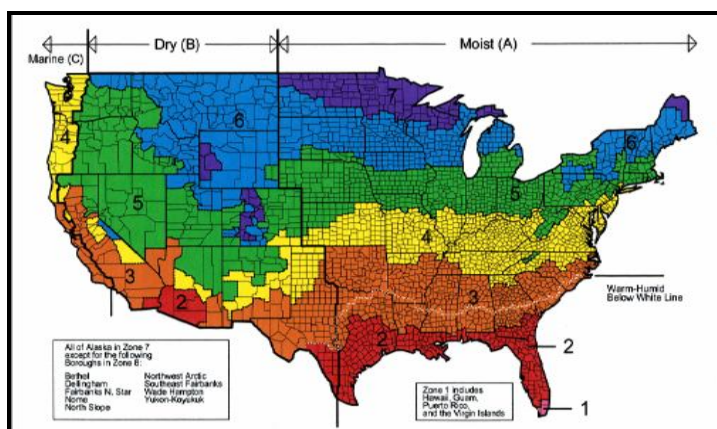

2. A dwelling unit, as defined by the 2009 IECC, is a single unit that provides complete independent living facilities for one or more persons, including permanent provisions for living, sleeping, eating, cooking, and sanitation.
3. Any above-grade story with 20% or more occupiable space, including commercial space, shall be counted towards the total number of stories for the purpose of determining eligibility to participate in the program. The definition of an 'above-grade story' is one for which more than half of the gross surface area of the exterior walls is above-grade. All below-grade stories, regardless of type, shall not be included when evaluating eligibility.
4. Per ASHRAE 62.2-2010, occupiable space is any enclosed space inside the pressure boundary and intended for human activities or continual human occupancy, including, but not limited to, areas used for living, sleeping, dining, and cooking, toilets, closets, halls, storage and utility areas, and laundry areas.
5. Central systems for domestic hot water are allowed if solar energy provides at least 50% of the domestic hot water needs for the residential units.
6. Units in multifamily buildings with 4 or 5 stories above-grade, including mixed-use buildings, that have their own heating, cooling, and hot water systems, separate from other units, but where dwelling units occupy less than 80% of the residential (i.e., excluding commercial / retail space for mixed-use buildings) occupiable square footage of the building may earn the ENERGY STAR through either the New Homes Program or the Multifamily High Rise Program if permitted prior to July 1, 2012. Units in buildings of this type that are permitted after this date shall only be eligible to earn the ENERGY STAR through the Multifamily High Rise (MFHR) Program.
7. Where requirements of the local codes, manufacturers' installation instructions, engineering documents, or regional ENERGY STAR programs overlap with the requirements of these guidelines, EPA offers the following guidance:
 - a. In cases where the overlapping requirements exceed the ENERGY STAR guidelines, these overlapping requirements shall be met;
 - b. In cases where overlapping requirements conflict with a requirement of these ENERGY STAR guidelines (e.g., slab insulation is prohibited to allow visual access for termite inspections), then the conflicting requirement within these guidelines shall not be met. Certification shall only be allowed if the Rater has determined that no equivalent option is available that could meet the intent of the conflicting requirement of these ENERGY STAR guidelines (e.g., switching from exterior to interior slab edge insulation). Note that, under the Performance Path, a home must still meet its ENERGY STAR HERS Index Target. Therefore, other efficiency measures may be needed to compensate for the omission of the conflicting requirement.
8. The average-size home with a specific number of bedrooms is termed the "Benchmark Home". The conditioned floor area of a Benchmark Home (CFA Benchmark Home) is determined by selecting the appropriate value from Exhibit 2. For homes with more than 8 bedrooms, the CFA Benchmark Home shall be determined by multiplying 600 sq. ft. times the total number of bedrooms and adding 400 sq. ft.

Example: CFA Benchmark Home for a 10 bedroom home = (600 sq. ft. x 10) + 400 sq. ft. = 6,400 sq. ft.

A bedroom is defined by RESNET as a room or space 70 sq. ft. or greater size, with egress window and closet, used or intended to be used for sleeping. A "den", "library", or "home office" with a closet, egress window, and 70 sq. ft. or greater size or other similar rooms shall count as a bedroom, but living rooms and foyers shall not.

An egress window, as defined in 2009 IRC section R310, shall refer to any operable window that provides for a means of escape and access for rescue in the event of an emergency. The egress window definition has been summarized for convenience. The egress window shall:

- have a sill height of not more than 44 in. above the floor; AND
- have a minimum net clear opening of 5.7 sq. ft.; AND
- have a minimum net clear opening height of 24 in.; AND



ENERGY STAR Certified Homes, Version 3 (Rev. 07)

County-Level Reference Design Notes

- have a minimum net clear opening width of 20 in.; AND
 - be operational from the inside of the room without the use of keys, tools or special knowledge.
9. To determine whether at least half of the basement wall area is below grade, use the gross surface area of the walls that are in contact with either the ground or ambient outdoor air, measured from the basement floor to the bottom of the basement ceiling framing (e.g., the bottom of the joists for the floor above). Note that the exception regarding the floor area in basements is only for the purpose of determining a home's Benchmark Home Size, Size Adjustment Factor, and eligibility to use the Prescriptive Path. The full conditioned floor area, per RESNET's standards, should be used when rating the home (e.g., determining compliance with duct leakage requirements).
10. The term 'Rater' refers to the person completing the third-party inspections required for certification. This person shall: a) be a certified Home Energy Rater, Rating Field Inspector, BOP Inspector, or an equivalent designation as determined by a Verification Oversight Organization such as RESNET; and, b) have attended and successfully completed an EPA-recognized training class. See www.energystar.gov/newhomestraining. Raters who operate under a Sampling Provider are permitted to verify the Minimum Rated Features of the home using the RESNET-approved sampling protocol.
11. The Rater may define the 'permit date' as either the date that the permit was issued or the date of the contract on the home. In cases where permit or contract dates are not available, Providers have discretion to estimate permit dates based on other construction schedule factors. These assumptions should be both defensible and documented.
12. Where ENERGY STAR certified heating or cooling systems are required, all installed equipment of that system type must be ENERGY STAR certified.
13. The required efficiency for air source heat pumps in Climate Zones 4, 5, & 6 exceed the ENERGY STAR minimum of 8.2 HSPF. Air source heat pumps with electric resistance backup heating cannot be used in homes certified in Climate Zones 7 & 8.
14. The following efficiency levels shall be used based on ground-source heat pump product type:
- Closed Loop Water-to-Air: ≥ 3.5 COP / 16.1 EER
 - Open Loop Water-to-Air: ≥ 3.8 COP / 18.2 EER
 - Direct Geo-Exchange (DGX): ≥ 3.6 COP / 16 EER
 - Closed Loop Water-to-Water: ≥ 3.0 COP / 15.1 EER
 - Open Loop Water-to-Water: ≥ 3.4 COP / 19.1 EER
15. Envelope leakage shall be determined by a Rater using a RESNET-approved testing protocol.
16. Insulation shall be verified by a Rater to achieve Grade I installation as defined in the RESNET Standards, except for ceiling, wall, and floor assemblies with continuous rigid insulation. For such homes, Grade II installation is acceptable for the cavity insulation only if the rigid insulation meets or exceeds the following levels: R-3 in Climate Zones 1 to 4; R-5 in Zones 5 to 8.
17. Insulation levels in a home shall meet or exceed the component insulation requirements in the 2009 IECC - Table 402.1.1. The following exceptions apply:
- a. Steel-frame ceilings, walls, and floors shall meet the insulation requirements of the 2009 IECC – Table 402.2.5. In CZ 1 and 2, the continuous insulation requirements in this table shall be permitted to be reduced to R-3 for steel-frame wall assemblies with studs spaced at 24 in. on center. This exception shall not apply if the alternative calculations in d) are used;
 - b. For ceilings with attic spaces, R-30 shall satisfy the requirement for R-38 and R-38 shall satisfy the requirement for R-49 wherever the full height of uncompressed insulation at the lower R-value extends over the wall top plate at the eaves. This exemption shall not apply if the alternative calculations in d) are used;
 - c. For ceilings without attic spaces, R-30 shall satisfy the requirement for any required value above R-30 if the design of the roof / ceiling assembly does not provide sufficient space for the required insulation value. This exemption shall be limited to 500 square ft. or 20% of the total insulated ceiling area, whichever is less. This exemption shall not apply if the alternative calculations in d) are used;
 - d. An alternative equivalent U-factor or total UA calculation may also be used to demonstrate compliance, as follows:
An assembly with a U-factor equal or less than specified in 2009 IECC Table 402.1.3 complies.
A total building thermal envelope UA that is less than or equal to the total UA resulting from the U-factors in Table 402.1.3 also complies. The insulation levels of all non-fenestration components (i.e., ceilings, walls, floors, and slabs) can be traded off using the UA approach under both the Prescriptive and the Performance Path. Note that fenestration products (i.e., windows, skylights, doors) shall not be included in this calculation. Also, note that while ceiling and slab insulation can be included in trade-off calculations, Items 4.1 through 4.3 of the Thermal Enclosure System Rater Checklist shall be met regardless of the UA tradeoffs calculated. The UA calculation shall be done using a method consistent with the ASHRAE Handbook of Fundamentals and shall include the thermal bridging effects of framing materials. The calculation for a steel-frame envelope assembly shall use the ASHRAE zone method or a method providing equivalent results, and not a series-parallel path calculation method.
18. Consistent with the 2009 IECC, slab edge insulation is only required for slab-on-grade floors with a floor surface less than 12 inches below grade. Slab insulation shall extend to the top of the slab to provide a complete thermal break. If the top edge of the insulation is installed between the exterior wall and the edge of the interior slab, it shall be permitted to be cut at a 45-degree angle away from the exterior wall.
19. All windows, doors, and skylights shall meet ENERGY STAR Program Requirements for Residential Windows, Doors, and Skylights – Version 5.0 as outlined at www.energystar.gov/windows. If no NFRC rating is noted on the window or in product literature (e.g., for site-built fenestration), select the U-factor and SHGC value from Tables 4 and 14, respectively, in 2005 ASHRAE



ENERGY STAR Certified Homes, Version 3 (Rev. 07)

County-Level Reference Design Notes

Fundamentals, Chapter 31. Select the highest U-factor and SHGC value among the values listed for the known window characteristics (e.g., frame type, number of panes, glass color, and presence of low-e coating). Note that the U-factor requirement applies to all fenestration while the SHGC only applies to the glazed portion. The following exceptions apply:

- a. An area-weighted average of fenestration products shall be permitted to satisfy the U-factor requirements;
 - b. An area-weighted average of fenestration products more than 50% glazed shall be permitted to satisfy the SHGC requirements;
 - c. 15 square feet of glazed fenestration per dwelling unit shall be exempt from the U-factor and SHGC requirements, and shall be excluded from area-weighted averages calculated using a) and b), above;
 - d. One side-hinged opaque door assembly up to 24 square feet in area shall be exempt from the U-factor requirements and shall be excluded from area-weighted averages calculated using a) and b), above;
 - e. Fenestration utilized as part of a passive solar design shall be exempt from the U-factor and SHGC requirements, and shall be excluded from area-weighted averages calculated using a) and b), above. Exempt windows shall be facing within 45 degrees of true South and directly coupled to thermal storage mass that has a heat capacity $> 20 \text{ btu} / \text{ft}^3 \times ^\circ\text{F}$ and provided in a ratio of at least 3 sq. ft. per sq. ft. of South facing fenestration. Generally, thermal mass materials will be at least 2 in. thick.
20. All decorative glass and skylight window areas count toward the total window area to above-grade conditioned floor area (WFA) ratio. For homes using the Prescriptive Path that have a WFA ratio $> 15\%$, the following additional requirements apply:
- a. In Climate Zones 1, 2, and 3, an improved window SHGC is required and is determined by:
Improved SHGC = $[0.15 / \text{WFA}] \times [\text{ENERGY STAR SHGC}]$
Where the ENERGY STAR SHGC is the maximum allowable SHGC in Exhibit 3, ENERGY STAR Reference Design, for the Climate Zone where the home will be built.
 - b. In Climate Zones 4, 5, 6, 7, and 8, an improved window U-Value is required and is determined by:
Improved U-Value = $[0.15 / \text{WFA}] \times [\text{ENERGY STAR U-Value}]$
Where the ENERGY STAR U-Value is the maximum allowable U-Value in Exhibit 3, ENERGY STAR Reference Design, for the Climate Zone where the home will be built.
21. To determine domestic hot water (DHW) EF requirements for additional tank sizes, use the following equations: Gas DHW EF $\geq 0.69 - (0.002 \times \text{Tank Gallon Capacity})$; Electric DHW EF $\geq 0.97 - (0.001 \times \text{Tank Gallon Capacity})$; Oil DHW EF $\geq 0.61 - (0.002 \times \text{Tank Gallon Capacity})$. The minimum efficiency for instantaneous water heaters shall be determined using the above equations and assuming a 1 gallon capacity.
- Domestic hot water systems that are integrated with the space-heating system are permitted to be used in the following two scenarios: either the space-heating system (e.g., furnace or boiler) shall heat and circulate a fluid through an indirect storage tank, or a single integrated/combined product intended for both space heating and domestic hot water shall be used. A 'tankless coil water heater', where domestic water flows through a coil installed in the space-heating system, is not permitted.
22. For homes with heat pumps that contain an electric resistance heating element used to supplement the capacity of the heat pump, the thermostat shall have 'Adaptive Recovery' technology to prevent the excessive use of the heating element.
23. Duct leakage shall be determined and documented by a Rater using a RESNET-approved testing protocol. Leakage limits shall be assessed on a per-system, rather than per-home, basis.
24. For homes that have $\leq 1,200$ sq. ft. of conditioned floor area, measured duct leakage to outdoors shall be ≤ 5 CFM25 per 100 sq. ft. of conditioned floor area. Testing of duct leakage to the outside can be waived if all ducts & air handling equipment are located within the home's air and thermal barriers AND envelope leakage has been tested to be less than or equal to half of the Prescriptive Path infiltration limit for the Climate Zone where the home is to be built. Alternatively, testing of duct leakage to the outside can be waived if total duct leakage is ≤ 4 CFM25 per 100 sq. ft. of conditioned floor area, or ≤ 5 CFM25 per 100 sq. ft. of conditioned floor area for homes that have less than 1,200 sq. ft. of conditioned floor area.
25. This only applies where refrigerators, dishwashers, ceiling fans, or exhaust fans are installed. All exhaust fans shall be ENERGY STAR certified, except in half bathrooms. A half bathroom is any bathroom that does not contain a bathtub, shower, spa, or similar source of moisture.
26. This requirement applies to RESNET-defined Qualifying Light Fixture Locations. Also note that the ENERGY STAR Advanced Lighting Package (ALP), which requires a minimum of 60% ENERGY STAR certified hard-wired fixtures and 100% ENERGY STAR certified ceiling fans, where installed, may also be used to comply with the lighting requirements.