

# ST 3000 Smart Transmitter 3-A Sanitary Remote Seal Models Specification 34-ST-03-26 August 2011



## Function

Honeywell's ST 3000 Transmitters with Remote Diaphragm Seals are available in 3-A Sanitary models for use in applications involving sanitary service.

The transmitter's electronics housing is available in Stainless Steel or Aluminum with baked vinyl enamel finish. Standard fill fluids are DC<sup>®</sup> 200 Silicone Oil and CTFE (Chlorotrifluoroethylene). Neobee<sup>™</sup> M20 fill fluid is optional.

Sanitary Seal Model	Reference Specification Number
STR12D	34-ST-03-64
STR13D	34-ST-03-64
STR14A	34-ST-03-64
STR14G	34-ST-03-64
STR17G	34-ST-03-64
STR93D	34-ST-03-57
STR94G	34-ST-03-57

Models		
STR12D	0 to 400 inH <sub>2</sub> O	0 to 1,000 mbar
STR13D	0 to 100 psid	0 to 7 barg
STR14A	0 to 500 psia	0 to 35 bara
STR14G	0 to 500 psig	0 to 35 barg
STR17G	0 to 600 psig	0 to 41 barg
STR93D	0 to 100 psid	0 to 7 barg
STR94G	0 to 500 psig	0 to 35 barg

## Advanced Diagnostics

ST 3000 is now available for both HART<sup>®</sup> 6 and Foundation<sup>™</sup> Fieldbus with advanced diagnostics that minimize unplanned plant outages, minimize maintenance costs and by providing the industry's most reliable transmitter.

- Provide advanced warning of possible failure events and avoid costly shutdowns.
- Three levels of failure reporting
- Comprehensive list of on-board diagnostics (Ref. ST 3000 User manual with HART<sup>®</sup> 6, 34-ST-25-17 Rev: June 09 and Foundation<sup>™</sup> Fieldbus option manual 34-ST-25-15 Rev: June 09)

## Mounting

### 3-A Sanitary Remote Seal Models with Gauge, Absolute, or Differential (Figure 1)

#### Pressure Transmitters—Models STR12D, STR13D, STR14A, STR14G, STR17G, STR93D, and STR94G

These models are designed to mount to a process with a sanitary clamp. The Tri-Clover Tri-Clamp Sanitary Seal (**Figure 2**) is available in 2-, 2-1/2-, 3-, and 4-inch sizes. Optional Cherry-Burrell “1” Line, APC Clamp, and Bevel Seat Sanitary Seals may be available.

Check the reference specifications for capillary length restrictions and typical transmitter and seal dimensions. The Sanitary Seal is 316 Stainless Steel.

**CAUTION:** The Maximum Allowable Working Pressure (MAWP) for pressure transmitters with sanitary clamp connections is the MAWP of the transmitter or the MAWP of the sanitary seal (if selected) or the MAWP of the sanitary clamp, which ever is **lowest**.

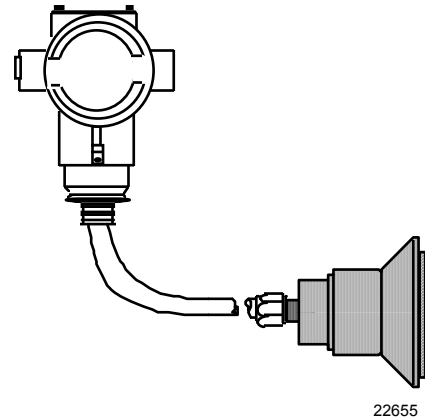


Figure 1 — STRXXG Gauge Pressure Transmitter with sanitary quick connect remote seal.


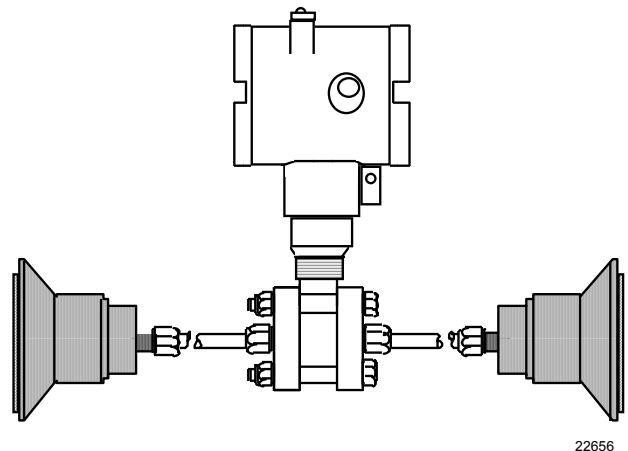


Figure 2 — Differential Pressure Transmitter with Sanitary Quick-Connect Remote Seals.

**Reference Dimensions**

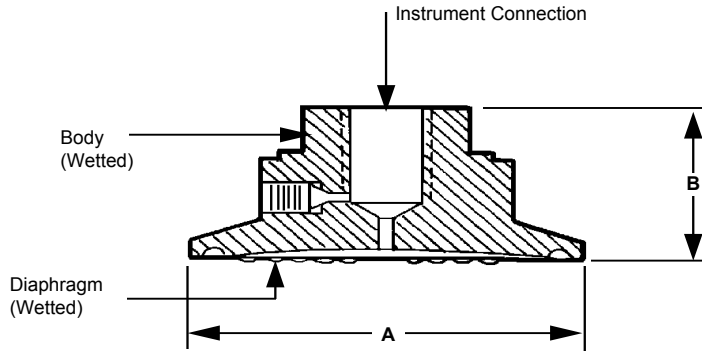

Reference Dimensions

Seal Size Inches (Millimeters)	Diaphragm Diameter Inches (Millimeters)	Dimension - Inches (Millimeters)	
		A	B
2 (50)	1.9 (48)	2.5 (63)	1.2 (30)
2.5 (63)	2.4 (61)	3.0 (76)	1.2 (30)
3 (76)	2.9 (73)	3.6 (91)	1.2 (30)
4 (101)	4.1 (104)	4.7 (119)	1.0 (25)

22652

**Figure 3**

—Typical Tri-Clover Tri-Clamp™ Seal design and reference dimensions. Note: Sanitary remote seals used on Honeywell ST pressure transmitters have separate 3-A authorization from the seal manufacturer

## Certifications

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
<b>FM Approvals<sup>SM</sup></b>	<b>Explosionproof:</b> Class I, Division 1, Groups A, B, C, D locations <b>Dust Ignition Proof:</b> Class II, III, Division 1, Groups E, F, G locations, Enclosure Type 4X	All	All	T5 Ta = 93°C
	<b>Intrinsically Safe:</b>  Class I, II, III, Division 1, Groups A, B, C, D, E, F, G locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42.4V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
		4-20 mA /	Vmax = 30V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
	<b>Intrinsically Safe:</b>  Class I, II, III, Division 1, Groups A, B, C, D, E, F, G locations;  Class 1, Zone 0, AEx ia Group IIC, Enclosure Type 4X / IP 66/67	Fieldbus – Entity (Not FISCO)	Vmax = 32V Imax = 120mA Ci = 4.2nF Li = 0 Pi = 0.84W	T4 Ta = 40°C T3 Ta = 93°C
		Fieldbus – Entity (Not FISCO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C
		FISCO	Vmax = 17.5V Imax = 380mA Ci = 4.2nF Li = 0 Pi = 5.32W	T4 Ta = 40°C T3 Ta = 93°C
	<b>Nonincendive:</b>  Class I, Division 2, Groups A, B, C, D locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42.4V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
		4-20 mA / HART	Vmax = 30V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C
	<b>Nonincendive:</b>  Class I, Division 2, Groups A, B, C, D;  Suitable for: Class II, Division 2, Groups F&G; Class III, Division 2; Class I, Zone 2, Group IIC, Enclosure Type 4X / IP 66/67	Fieldbus – Entity (Not FNICO)	Vmax = 32V Imax = 120mA Ci = 4.2nF Li = 0 Pi = 0.84W	T4 Ta = 40°C T3 Ta = 93°C
		Fieldbus – Entity (Not FNICO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C
		FNICO	Vmax = 32V Ci = 4.2nF Li = 0	T4 Ta = 40°C T3 Ta = 93°C

Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

FM Approvals<sup>SM</sup> is a service mark of FM Global

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes	
<b>Canadian Standards Association (CSA)</b>	<b>Explosion Proof:</b> Class I, Division 1, Groups B, C, D locations <b>Dust Ignition Proof:</b> Class II, III, Division 1, Groups E, F, G locations, Enclosure Type 4X	All	All	T4 Ta = 93°C	
	<b>Intrinsically Safe:</b>  Class I, II, III, Division 1, Groups A, B, C, D, E, F, G locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		4-20 mA / HART	Vmax = 42V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		Fieldbus – Entity (Not FISCO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C	
	<b>Nonincendive:</b>  Class I, Division 2, Groups A, B, C, D locations, Enclosure Type 4X	4-20 mA / DE	Vmax = 42.4V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		4-20 mA / HART	Vmax = 30V Imax = 225mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = 93°C	
		Fieldbus – Entity (Not FNICO)	Vmax = 24V Imax = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T4 Ta = 40°C T3 Ta = 93°C	
	<b>Canadian Registration Number (CRN):</b>	All ST 3000 models except STG19L, STG99L, STG170 and STG180 have been registered in all provinces and territories in Canada and are marked CRN: 0F8914.5C.			

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
<b>IECEX International Electrotechnical Commission (LCIE)</b>	<b>Flameproof, Zone 1:</b> Ex d IIC, Enclosure IP 66/67	All	All	T5 Ta = -50 to 93°C T6 Ta = -50 to 78°C
	<b>Intrinsically Safe, Zone 0/1:</b> Ex ia IIC, Enclosure IP 66/67	4-20 mA / DE	Ui = 30V li = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V li = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	Ui = 24V li = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

\* Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
<b>SAEx (South Africa)</b>	<b>Flameproof, Zone 1:</b> Ex d IIC, Enclosure IP 66/67	All	All	T5 Ta = -50 to 93°C T6 Ta = -50 to 78°C
	<b>Intrinsically Safe, Zone 0/1:</b> Ex ia IIC, Enclosure IP 66/67	4-20 mA / DE	Ui = 30V li = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V li = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	Ui = 24V li = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C
	<b>Multiple Marking:</b> <b>Flameproof, Zone 1:</b> Ex d IIC, Enclosure IP 66/67	4-20 mA / DE	Ui = 30V li = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
	<b>Intrinsically Safe, Zone 0/1:</b> Ex ia IIC, Enclosure IP 66/67  The user must determine the type of protection required for installation of the equipment. The user shall then check the box [√] adjacent to the type of protection used on the equipment certification nameplate. Once a type of protection has been checked on the nameplate, subsequently the equipment shall not be reinstalled using any of the other certification types.	4-20 mA / HART	Ui = 30V li = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	Ui = 24V li = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

\* Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
ATEX (LCIE)	<b>Flameproof, Zone 0:</b> ⊕ II 1 D, Ex tD Enclosure IP 66/67	All	All	A20 IP6X T95°C Ta = 93°C or T80°C Ta = 78°C
	<b>Flameproof, Zone 1:</b> ⊕ II 2 GD, Ex d IIC, Ex tD Enclosure IP 66/67	All	All	T5 Ta = -50 to +93°C T6 Ta = -50 to +78°C, A21 IP6X T95°C Ta = 93°C or T80°C Ta = 78°C
	<b>Intrinsically Safe, Zone 0/1:</b> ⊕ II 1 G, Ex ia IIC, Enclosure IP 66/67	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C
	<b>Non-Sparking, Zone 2:</b> ⊕ II 3 G, Ex nA IIC (Honeywell), Enclosure IP 66/67	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FNICO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C
	<b>Multiple Marking:</b> <b>Flameproof, Zone 1:</b> ⊕ II 2 G, Ex d IIC <b>Intrinsically Safe, Zone 0/1:</b> ⊕ II 1 G, Ex ia IIC <b>Non-Sparking, Zone 2:</b> ⊕ II 3 G, Ex nA IIC  <b>NOTE:</b> The user must determine the type of protection required for installation of the equipment. The user shall then check the box [ √ ] adjacent to the type of protection used on the equipment certification nameplate. Once a type of protection has been checked on the nameplate, subsequently the equipment shall not be reinstalled using any of the other certification types.	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO/FNICO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

\* Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

	Type of Protection	Comm. Option	Field Parameters	Temp. Codes
<b>INMETRO (CERTUSP) Brazil</b>	<b>Flameproof, Zone 1:</b> BR-Ex d IIC Enclosure IP 66/67	All	All	T5 Ta = -50 to 93°C T6 Ta = -50 to 78°C
	<b>Intrinsically Safe, Zone 0/1:</b> BR-Ex ia IIC Enclosure IP 66/67	4-20 mA / DE	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 85°C T6 Ta = -50 to 70°C
		4-20 mA / HART	Ui = 30V Ii = 100mA Ci = 4.2nF Li = * Pi = 1.2W	T4 Ta = -50 to 93°C T5 Ta = -50 to 63°C T6 Ta = -50 to 48°C
		Fieldbus (Not FISCO)	Ui = 24V Ii = 250mA Ci = 4.2nF Li = 0 Pi = 1.2W	T3 Ta = -50 to 93°C T4 Ta = -50 to 40°C

\* Li = 0 except Li = 150µH when Option ME, Analog Meter, is selected.

<b>ST 3000 Pressure Transmitter Marine Certificate (MT Option)</b>	This certificate defines the certifications covered for the ST 3000 Pressure Transmitter family of products, including the SMV 3000 Smart Multivariable Transmitter. It represents the compilation of the five certificates Honeywell currently has covering the certification of these products into marine applications.  For ST 3000 Smart Pressure Transmitter and SMV 3000 Smart Multivariable Transmitter
	<b>American Bureau of Shipping (ABS)</b> - 2009 Steel Vessel Rules 1-1-4/3.7, 4-6-2/5.15, 4-8-3/13 & 13.5, 4-8-4/27.5.1, 4-9-7/13. Certificate number: 04-HS417416-PDA
	<b>Bureau Veritas (BV)</b> - Product Code: 389:1H. Certificate number: 12660/B0 BV
	<b>Det Norske Veritas (DNV)</b> - Location Classes: Temperature D, Humidity B, Vibration A, EMC B, Enclosure C. For salt spray exposure; enclosure of 316 SST or 2-part epoxy protection with 316 SST bolts to be applied. Certificate number: A-11476
	<b>Korean Register of Shipping (KR)</b> - Certificate number: LOX17743-AE001
	<b>Lloyd's Register (LR)</b> - Certificate number: 02/60001(E1) & (E2)



<p><b>European Pressure Equipment Directive (PED) (97/23/EC)</b></p>	<p>The ST 3000 Smart Pressure Transmitters are in conformity with the essential requirements of the Pressure Equipment Directive.</p> <p>Honeywell ST 3000 Smart Pressure Transmitters are designed and manufactured in accordance with the applicable portions of Annex I, Essential Safety Requirements, and sound engineering practices. These transmitters have no pressurized internal volume, or have a pressurized internal volume rated less than 200 bar (2,900 psig), and/or have a maximum volume of less than 0.1 liter (Article 3, 1.1.(a) first indent, Group 1 fluids). Therefore, these transmitters are not subject to the essential requirements of the directive 97/23/EC (PED, Annex I) and shall not have the CE mark applied.</p> <p>For transmitters rated &gt; 200 bar (2,900 psig) &lt; 1,000 bar (14,500 psig) Honeywell maintains a technical file in accordance with Annex III, Module A, (internal production control) when the CE mark is required. Transmitter Attachments: Diaphragm Seals, Process Flanges and Manifolds comply with Sound Engineering Practice.</p> <p><b>NOTE:</b> Pressure transmitters that are part of safety equipment for the protection of piping (systems) or vessel(s) from exceeding allowable pressure limits, (equipment with safety functions in accordance with Pressure Equipment Directive 97/23/EC article 1, 2.1.3), require separate examination.</p> <p>A formal statement from TÜV Industry Service Group of TÜV America, Inc., a division of TÜV Süddeutschland, a Notified Body regarding the Pressure Equipment Directive, can be found at <a href="http://www.honeywell.com">www.honeywell.com</a>. A hard copy may be obtained by contacting a Honeywell representative.</p>
<p><b>CE Mark</b></p>	<p><b><i>Electro Magnetic Compatibility (EMC) (2004/108/EC)</i></b> All Models: EN 50081-1: 1992; EN 50082-2:1995; EN 61326-1:1997 + A1, A2, and A3 – Industrial Locations</p>
<p><b>Dual Seal Certification</b></p>	<p>Dual Seal Certification based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.01 requirements without the use of additional seal protection elements.</p>
<p><b>Recommended Frequency of Calibration</b></p>	<p>Honeywell recommends verifying the calibration of these devices once every four years.</p>
<p><b>Approved Manufacturing Locations</b></p>	<p>Honeywell Process Solutions - York, PA USA Honeywell (Tianjin) Limited – Tianjin, P.R. China Honeywell Automation India Ltd. – Pune 411013 India</p>

Foundation™ Fieldbus is a trademark of the Fieldbus Foundation.

HART® is a registered trademark of HART Communications Foundation.

Hastelloy® C-276 is a registered trademark of Haynes International.

Monel® 400 is a registered trademark of Special Metals Corporation.

ST 3000® and Experion® are registered trademarks of Honeywell International Inc.

Tri-Clamp™ is a trademark of Alfa-Laval.

Neeobe® is a registered trademark of Stephan Company

Viton® is a registered trademark of DuPont

Teflon® is a registered trademark of DuPont.

DC® 200 is a registered trademark of Dow Corning.

FM Approvals<sup>SM</sup> is a service mark of FM Global

## Options

- **Mounting Bracket (Options MB, MX, SB, SX, FB)**  
The mounting bracket is available in either zinc-plated carbon steel or stainless steel and is suitable for horizontal or vertical mounting on a two inch (50 millimeter) pipe, as well as wall mounting. An optional flat mounting bracket is also available in carbon steel for two inch (50 millimeter) pipe mounting. An option also exists for Marine approved mounting brackets used with Marine certification options.
- **Indicating Meter (Options ME and SM)**  
Two integral meter options are available. An analog meter (option ME) is available with a dual 0 to 10 square root and 0 to 100% linear scale. The Smart Meter (option SM) provides an LCD display for both analog and digital output and can be configured to display pressure in selected engineering units.
- **HART<sup>®</sup> Output Protocol (Options HC and H6)**  
Optional electronic modules for the ST 3000 provide HART<sup>®</sup> Protocol compatibility in either HART<sup>®</sup> 5.x or 6.x formats. Transmitters with a HART<sup>®</sup> Option are compatible with any HART<sup>®</sup> enabled system that provides 5.x or 6.x format support.
- **Foundation<sup>™</sup> Fieldbus Output (Option FF)**  
Equips transmitter with FF protocol for use in 31.25 kbit/s FF networks. See document 34-ST-03-72 for additional information on ST 3000 Fieldbus transmitters.
- **SIL2/SIL3 Certification (Option SL)**  
This ST 3000 product is available for use with safety systems. With the SL option, we are fully certified to SIL 2 capability for single transmitters and SIL 3 capability for multiple transmitter use through TÜV Nord Sys Tec GmbH & Co. KG. We are in compliance with the following SIL standards:

  - IEC 61508-1: 1998;
  - IEC 61508-2: 2000;
  - IEC 61508-3: 1998
- **Lightning Protection (Option LP)**  
A terminal block is available with circuitry that protects the transmitter from transient surges induced by nearby lightning strikes.
- **NAMUR NE43 Compliance (Option NE)**  
This option provides software that meets the NAMUR NE43 requirements for failsafe software. Transmitter failure information is generated when the measuring information is no longer valid.  
  
Transmitter failure values are  $\leq 3.6$  mA and  $\geq 21.0$  mA.  
  
The normal ST 3000 ranges are  $\leq 3.8$  mA and  $\geq 20.8$  mA.
- **Write Protection (Options WP and WX)**  
Provides the capability to hardwire write-protect installed transmitter configurations.
- **Stainless Steel Tagging (Option TG)**  
Up to 30 characters can be added on the stainless steel nameplate mounted on the transmitter's electronics housing at no extra cost. A stainless steel wired on tag with additional data of up to 4 lines of 28 characters is also available. The number of characters for tagging includes spaces.
- **Transmitter Configuration (Options TC and FC)**  
With Option TC, the factory can configure the analog, DE or HART<sup>®</sup> transmitter's linear/square root extraction, damping time, LRV, URV and mode (analog/digital) and enter an ID tag of up to eight characters and scratchpad information as specified.  
  
With Option FC, the Device ID, Transmitter Tag, Unit Level Node Address, Output Mode and Damping Time Constants can be specified.
- **Custom Calibration and ID in Memory (Option CC)**  
The factory can calibrate any range within the scope of the transmitter's range and enter an ID tag of up to eight characters in the transmitter's memory.
- **Indicator Configuration (Option CI)**  
Provides custom configuration of Smart Meters
- **Lifetime Warranty (Option WL)**  
Extends limited 1-year warranty policy to 15 years for ST 3000 S100 pressure transmitters. See Honeywell Terms and Conditions.

## Sales and Service

For application assistance, current specifications, pricing, or name of the nearest Authorized Distributor, contact one of the offices below.

**Asia Pacific Global  
Technical Support  
Field Instruments**

Phone: +65 6580 3156  
Fax: +65 6445-3033

**Australia**

Honeywell Limited  
Phone: +(61) 7-3846 1255  
FAX: +(61) 7-3840 6481  
Toll Free 1300-36-39-36  
Toll Free Fax:  
1300-36-04-70

**China – PRC - Beijing**

Honeywell China Inc.  
Phone: +(86-10) 8458-3280  
Fax: +(86-10) 8458-4650

**China – PRC - Shanghai**

Honeywell China Inc.  
Phone: (86-21) 5257-4568  
Fax: (86-21) 6237-2826

**China – PRC - Chengdu**

Honeywell China Inc.  
Phone: +(86-28) 6613-5078  
Fax: +(86-28) 8678-7061

**China – PRC - Xi'an**

Honeywell China Ltd - Xi'an.  
Phone: +(86-29) 8833-7490  
Fax: +(86-29) 8833-7489

**China – PRC - Shenzhen-**

Honeywell China Inc.  
Phone: +(86) 755-2518-1226  
Fax: +(86) 755-2518-1221

**Indonesia**

PT Honeywell Indonesia  
Phone: +(62) 21-535-8833  
FAX: +(62) 21-5367 1008

Honeywell Automation  
India Ltd.

Honeywell Ltd.  
Phone: +(91) 6603-9400  
Fax: +(91) 6603-9600

**Japan**

Honeywell Inc.  
Phone: +(81) 3 6730 7197  
Fax: +(81) 3 6730 7228

**Malaysia**

Honeywell Engineering  
Sdn Bhd  
Phone: +(603) 7958-4788  
Fax: +(603) 7958-8922

**New Zealand**

Honeywell Limited  
Phone: +(64-9) 623-5050  
Fax: +(64-9) 623-5060  
Toll Free (0800) 202-088

**Singapore**

Honeywell Pte Ltd.  
Phone: +(65) 6580 3278  
Fax: +(65) 6445-3033

**South Korea**

Honeywell Korea Co Ltd  
Phone: +(822) 799 6114  
Fax: +(822) 792 9015

**Thailand**

Honeywell Systems  
(Thailand) Ltd.  
Phone: +(662) 693-3099  
FAX: +(662) 693-3089

**Taiwan R.O.C.**

Honeywell Taiwan Ltd.  
Phone: +(886-2) 2245-1000  
FAX: +(886-2) 2245-3243

**SE Asia Countries**

see Honeywell Pte Ltd  
(Singapore)  
for: Philippines, Pakistan,  
Cambodia, Guam, Laos,  
Myanmar, Vietnam,  
East Timor

**SE Asia Countries**

see Honeywell  
Automation India Ltd for:  
Bangladesh  
Nepal  
Sri Lanka

**EUROPE**
**Austria**

Honeywell Austria GmbH  
Phone: +43 (316)400123  
FAX: +43 (316)40017

**Belgium**

Honeywell SA/NV  
Phone: +32 (0)2728 24 07  
FAX: +32 (0)2728 22 45

**Bulgaria**

Honeywell EOOD  
Phone: +(359) 2 40 20  
900  
FAX: +(359) 2 40 20 990

**Czech Republic**

Honeywell spol. s.r.o.  
Phone: +420 242 442 232  
FAX: +420 242 442 131

**Denmark**

Honeywell A/S  
Phone: +(45) 39 55 55 55  
FAX: +(45) 39 55 55 58

**Finland**

Honeywell OY  
Phone: +358 (0)20752 2753  
FAX: +358 (0) 20752 2751

**France**

Honeywell SA  
Phone: +33 (0)1 60198075  
FAX: +33 (0)1 60198201

**Germany**

Honeywell AG  
Phone: +49 (69)8064-299  
FAX: +49 (69)806497336

**Hungary**

Honeywell Kft.  
Phone: +36-1-451 4300  
FAX: +36-1-451 4343

**Italy**

Honeywell S.p.A.  
Phone: +390292146307  
FAX: +39 0292146377

**The Netherlands**

Honeywell B.V.  
Phone: +31 (0) 20 5656200  
FAX: +31 (0) 20 5656210

**Norway**

Honeywell A/S  
Phone: (45) 39 55 55 55

**Poland**

Honeywell Sp. zo.o  
Phone: +48-22-6060900  
FAX: +48-22-6060901

**Portugal**

Honeywell Portugal Lda  
Phone: +351 21 424 5000  
FAX: +351 21 424 50 99

**Romania**

Honeywell Bucharest  
Phone: +40 (0) 21 2316437  
FAX: +40 (0) 21 2316439

**Russian Federation (RF),**

Honeywell Field Solutions  
Kievskaya str., 7,  
Moscow 121059, Russia  
Phone +7 (495) 796 98 60  
Fax +7 (495) 797 99 64

**Slovak Republic**

Honeywell s.r.o.  
Phone: +421-2-58247 410  
FAX: +421-2-58247 415

**Spain**

Honeywell S.A.  
Phone: +34 (0)91313 61 00  
FAX: +34 (0)91313 61 30

**Sweden**

Honeywell AB  
Phone: +(46) 8 775 55 00  
FAX: +(46) 8 775 56 00

**Switzerland**

Honeywell AG  
Phone: +41 18552448  
FAX: +(41) 1 855 24 45

**Turkey**

Honeywell Turkey A.S.  
Phone: +90 216 578 71 00  
FAX: +90 216 575 66 35

**Ukraine**

Honeywell  
Tel: +380-44-201 44 74  
Fax: +380-44-201-44-75

**United Kingdom**

Honeywell Control Systems  
Ltd.  
Phone: +44 (0)1344 655251  
FAX: +44 (0) 1344 655554

**MIDDLE EAST**
**Abu Dhabi U A E**

Middle East Headquarters  
Honeywell Middle East Ltd.  
Phone: +971 2 4041246  
FAX: +971 2 4432536

**Sultanate of Oman**

Honeywell & Co Oman LLC  
Phone: +968 24 701153/  
Ext.33  
FAX +968 24 787351

**Saudia Arabia**

Honeywell Turki Arabia Ltd  
**Jubail Office**  
Phone: +966-3-341-0140  
Fax: +966-3-341-0216  
Honeywell - ATCO  
**Dammam Office**  
Phone: 0096638304584  
Fax: 0096638338059

**Kuwait**

Honeywell Kuwait KSC  
Phone: +965 242 1327 to 30  
Fax: +965 242 8315  
And  
Phone: +965 326  
2934/1821Fax: +965 326  
1714

**AFRICA**
**Mediterranean & African**
**Distributors**

Honeywell SpA  
Phone: +39 (02) 250 10 604  
FAX: +39 (02) 250 10 659

**South Africa (Republic of)  
and sub saharan**

Honeywell Southern Africa  
Honeywell S.A. Pty. Ltd.  
Phone: +27 11 6958000  
FAX +27 118051504

**NORTH AMERICA**
**Canada**

Honeywell LTD  
Phone: 1-800-737-3360  
FAX: 1-800-565-4130

**USA**
**Honeywell Process**
**Solutions,**

Phone: 1-800-423-9883

Or 1-800-343-0228

Email: [ask-](mailto:ask-ssc@honeywell.com)

[ssc@honeywell.com](mailto:ssc@honeywell.com)

**SOUTH AMERICA**
**Argentina**

Honeywell S.A.I.C.  
Phone: +(54-11) 4383-3637  
FAX: +(54-11) 4325-6470

**Brazil**

Honeywell do Brasil & Cia  
Phone: +(55-11) 7266-1900  
FAX: +(55-11) 7266-1905

**Chile**

Honeywell Chile, S.A.  
Phone: +(56-2) 233-0688  
FAX: +(56-2) 231-6679

**Mexico**

Honeywell S.A. de C.V.  
Phone: +(52) 55 5259-1966  
FAX: +(52) 55 5570-2985

**Puerto Rico**

Honeywell Inc.  
Phone: +(809) 792-7075  
FAX: +(809) 792-0053

**Trinidad**

Honeywell Inc.  
Phone: +(868) 624-3964  
FAX: +(868) 624-3969

**Venezuela**

Honeywell CA  
Phone: +(58-2) 238-0211  
FAX: +(58-2) 238-3391

Model Selection Guides are subject to change and are inserted into the specifications as guidance only. Prior to specifying or ordering a model check for the latest revision Model Selection Guides which are published at: <http://hpsweb.honeywell.com/Cultures/en-US/Products/Instrumentation/ProductModelSelectionGuides/default.htm>

**Model Selection Guide 34-ST-16-32 for ST 3000 Smart Transmitters (DP, GP & AP) Remote Seals Series 100**



34-ST-16U-32  
Issue 50  
Page 1 of 12


# ST 3000 Smart Transmitter (DP, GP & AP) Remote Seals Series 100

## Model Selection Guide



**Instructions**

- Select the desired Key Number. The arrow to the right marks the selection available.
- Make selections from each Table (I, II and IV) using the column below the proper arrow.
- Select as many Table III options as desired plus a communications option selection.
- A (●) denotes unrestricted availability. A letter denotes restricted availability.
- Restrictions follow Table IV.



**KEY NUMBER**

Description	Selection	Availability		
<b>0-4" to 0-400" H<sub>2</sub>O / 0-10 to 0-1,000 mbar</b> Body Rating*: 2,500 psi (172 bar) - Compound Characterized	STR12D	↓		
<b>0-1 to 0-100 psi / 0-0.07 to 0-7 bar</b> Body Rating*: 2,500 psi (172 bar)	STR13D	↓		
<b>0-5 to 0-500 psia / 0-0.34 to 0-35 bar A</b> Body Rating*: 500 psia (35 bar A)	STR14A		↓	
<b>0-5 to 0-500 psi / 0-0.34 bar to 0-35 bar</b> Body Rating*: 500 psi (35 bar)	STR14G			↓
<b>0-30 to 0-3,000 psi / 0-2.1 bar to 210 bar</b> Body Rating*: 3,000 psi (210 bar)	STR17G			↓

\* Remote seal system pressure rating is body rating or seal rating, whichever is less.

Important Note: Base STR models no longer include a default communications option. All units now require the selection of a communication option from Table III (AN, DE, HC, H6 or FF).

**TABLE I - METER BODY**

		Selection			
Number of Seals	1 Remote Seal (High Side)	1 __	●	●	●
	2 Remote Seals	2 __	●		
	1 Remote Seal (Low Side)	3 __	●		
	Value Added Model (VAM unit)	5	8	8	8
Fill Fluid (Meter body)	DC <sup>®</sup> 200 Silicone	- 1 _	●	●	●
	CTFE	- 2	q	q	q
Construction	<b>Non-Wetted Adapter Head Material</b>				
In-Line Gauge	316 SS Bonnet	-- A			●
	316 SS Bonnet for Close-Couple	-- D			y
Dual Head DP	316 SS (bolt-on heads)	-- A	●		
	316 SS for Close-Couple	-- D	y		
	316 SS with all-welded meter body	-- C	7		
Single Head Absolute	316 SS Adapter Head	-- A		●	
	316 SS Head for Close-Couple	-- D		y	



In-Line Gauge



Dual Head DP



All welded

34-ST-16U-32  
Issue 50  
Page 2 of 12

**TABLE II - SEALS**

Format for Seal Selection:  
Specify 12 characters



Common		Required Seal		Selection			
<b>Note:</b> The first 3 characters are common to all seals. When selecting required seal, you must specify only the 9 selections within the required seal.				12D & 13D	14A	14G & 17G	
Secondary Fill				0	3	3	
Silicone (DC <sup>®</sup> 200)				1	•	•	
CTFE				2	•	•	
Silicone (DC <sup>®</sup> 704)				3	•	•	
Neobee <sup>®</sup> (M20) <sup>2</sup>				4	•	•	
Syltherm <sup>®</sup> 800 <sup>3</sup>				5	•	•	
No Capillary, No Nipple				_0	3	3	
 Connection of Remote Seal to Meter Body	Capillary Length	SS Armor		_A	•	•	
		PVC Coated SS Armor		_B	•	•	
		5 feet 1.5 m		_C	•	•	
		10 feet 3.0 m		_D	•	•	
		15 feet 4.5 m		_E	•	•	
		20 feet 6.1 m		_F	•	•	
	25 feet 7.5 m		_G	•	•		
	35 feet 10.7 m		_H	•	•		
	2 inch long SS nipple close-coupled		_I	•	•		
	2 inch long SS nipple close-coupled		_J	•	•		
	2 inch long SS nipple close-coupled		_K	•	•		
	2 inch long SS nipple close-coupled		_L	•	•		
	2 inch long SS nipple close-coupled		_M	•	•		
	No Selection				_0	•	•
No Seal Attached to Core Transmitter				_000000000	3	3	
 Flush Flanged Seal	Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>	Selection			
	3.5"	3"	ANSI Class 150	_AFA	•	•	
		80mm	ANSI Class 300	_AFC	•	•	
			DIN DN80-PN40	_AFM	•	•	
	Wetted Material		Diaphragm	Upper Insert	Selection		
			316L SS	316L SS	_AA	•	•
			Hastelloy <sup>®</sup> C-276	316L SS	_AB	•	•
			Hastelloy <sup>®</sup> C-276	Hastelloy <sup>®</sup> C-276	_AC	•	•
			Monel 400 <sup>®</sup>	Monel 400 <sup>®</sup>	_AE	•	•
			Tantalum <sup>5</sup>	316L SS	_AF	1	1
	Non-Wetted Material (upper)		CS (Nickel Plated)		_1	•	•
			316L SS		_2	•	•
Seal-Capillary Connection		Center Seal		_1	•	•	
		Side Seal		_2	9	9	
Calibration Rings		None		_A	•	•	
		316L SS		_B	5	5	
		Hastelloy <sup>®</sup> C-276		_C	5	5	
		Monel 400 <sup>®</sup>		_D	5	5	

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.  
<sup>2</sup> Limited vacuum availability.  
<sup>3</sup> Minimum static pressure requirement. No vacuum allowed. See Specifications Figure 15.  
<sup>5</sup> Tantalum Upper insert has Tantalum wetted parts and 316 SS or CS non-wetted parts  
**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-32  
Issue 50  
Page 3 of 12

TABLE II - SEALS (continued)


		Selection				
		STR12D & 13D	STR14A	14G & 17G		
 <p>Flush Flanged Seal</p>	Flushing Connections and Plugs <sup>4</sup> (Metal plug material will be the same as Cal. ring material if metal plug is chosen - SS Plug for CS Lower)	None	0	•	•	•
	One 1/4" with plastic plug	H	6	6	6	
	One 1/4" with metal plug	J	6	6	6	
	Two 1/4" with plastic plugs	M	6	6	6	
	Two 1/4" with metal plugs	N	6	6	6	
	One 1/2" with plastic plug	P	6	6	6	
	One 1/2" with metal plug	Q	6	6	6	
	Two 1/2" with plastic plugs	R	6	6	6	
	Two 1/2" with metal plugs	S	6	6	6	

Table II continued below

TABLE II - SEALS (continued)


		Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>	Const. - See Spec. Figure 34-ST-03-64	Construction - See Spec. Figure 34-ST-03-64	Selection		
							STR12D & 13D	STR14A	14G & 17G
 <p>Flush Flanged Seal with Lower</p>	2.4"	1"	ANSI 150	22	--- BCA ---	t	4	•	
			ANSI 300	22	--- BCC ---	t	4	•	
		1-1/2"	ANSI 150	22	--- BGA ---	t	4	•	
			ANSI 300	22	--- BGC ---	t	4	•	
		2"	ANSI 150	22	--- BDA ---	t	4	•	
			ANSI 300	22	--- BDC ---	t	4	•	
		3"	ANSI 150	22	--- BFA ---	t	4	•	
			ANSI 300	22	--- BFC ---	t	4	•	
	2.9"	1/2"	ANSI 150	23	--- CAA ---	•	•	•	
			ANSI 300	23	--- CCA ---	•	•	•	
		1"	ANSI 150	23	--- CCC ---	•	•	•	
			ANSI 300	22	--- CGA ---	•	•	•	
		1-1/2"	ANSI 150	22	--- CGC ---	•	•	•	
			ANSI 300	22	--- CGC ---	•	•	•	
		2"	ANSI 150	22	--- CDA ---	•	•	•	
			ANSI 300	22	--- CDC ---	•	•	•	
	4.1"	1/2"	ANSI 150	22	--- DAA ---	•	•	•	
			ANSI 300	23	--- DCA ---	•	•	•	
		1"	ANSI 150	23	--- DCC ---	•	•	•	
			ANSI 300	23	--- DCC ---	•	•	•	
1-1/2"		ANSI 150	23	--- DGA ---	•	•	•		
		ANSI 300	23	--- DGC ---	•	•	•		
2"		ANSI 150	23	--- DDA ---	•	•	•		
		ANSI 300	22	--- DDC ---	•	•	•		
3"	ANSI 150	22	--- DFA ---	•	•	•			
	ANSI 300	22	--- DFC ---	•	•	•			

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.  
<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation  
**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-32  
 Issue 50  
 Page 4 of 12

TABLE II - SEALS (continued)


		Diaphragm	Lower	Selection	STR12D & 13D	STR14A	14G & 17G	
 <p>Flush Flanged Seal with Lower</p>	Wetted Material	316L SS	316L SS	----- BA -----	•	•	•	
		Hastelloy® C-276	316L SS	----- BB -----	•	•	•	
		Hastelloy® C-276	Hastelloy® C-276	----- BC -----	•	•	•	
		Monel 400®	Monel 400®	----- BE -----	•	•	•	
		Tantalum	316L SS	----- BF -----	1	1	1	
		Tantalum	Hastelloy® C-276	----- BG -----	1	1	1	
			Tantalum	Tantalum Clad	----- BH -----	10	10	10
	Non-Wetted Material (upper, upper insert)	Upper	Upper Insert	Selection				
		316L SS	316L SS	----- 4 -----	•	•	•	
		Carbon Steel	316L SS	----- 5 -----	•	•	•	
	Bolts <sup>6</sup>	No Selection		----- 0 -----	•	•	•	
	Flushing Connections and Plugs <sup>4</sup> (Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)	None		----- 0 -----	•	•	•	
		One 1/4" with plastic plug		----- H -----	•	•	•	
		One 1/4" with metal plug		----- J -----	•	•	•	
		Two 1/4" with plastic plugs		----- M -----	•	•	•	
	Two 1/4" with metal plugs		----- N -----	•	•	•		
	One 1/2" with plastic plug		----- P -----	•	•	•		
	One 1/2" with metal plug		----- Q -----	•	•	•		
	Two 1/2" with plastic plugs		----- R -----	•	•	•		
	Two 1/2" with metal plugs		----- S -----	•	•	•		
Gasket	Klinger® C-4401 (non-asbestos)		----- K -----	c	c	c		
	Grafoil®		----- G -----	•	•	•		
	Teflon®		----- T -----	c	c	c		
	Gylon® 3510		----- L -----	d	d	d		

Table II continued below

TABLE II - SEALS (continued)


		Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>	Selection	STR12D & 13D	STR14A	14G & 17G
 <p>Flange Seal with Extended Diaphragm</p>	2.8"	3" (2.8" OD extension)	ANSI Class 150	----- EFA -----	•	•	•	
			ANSI Class 300	----- EFC -----	•	•	•	
			DIN DN80-PN40	----- EFM -----	•	•	•	
	3.5"	4" (3.70" OD extension)	ANSI Class 150	----- FGA -----	•	•	•	
			ANSI Class 300	----- FGC -----	•	•	•	
			DIN DN100-PN40	----- FGP -----	•	•	•	
	Wetted Material	Diaphragm	Ext. Tube	Selection				
		316L SS	316L SS	----- EA -----	•	•	•	
		Hastelloy® C-276	316L SS	----- EB -----	•	•	•	
		Hastelloy® C-276	Hastelloy® C-276	----- EC -----	•	•	•	
Non-Wetted Material (flange)	CS (Nickel Plated)		----- 7 -----	•	•	•		
	316L SS		----- 8 -----	•	•	•		
Bolts	No Selection		----- 0 -----	•	•	•		
Extension Length	2"		----- 2 -----	•	•	•		
	4"		----- 4 -----	•	•	•		
	6"		----- 6 -----	•	•	•		
No Selection	No Selection	No Selection	----- 0 -----	•	•	•		

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.

<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

<sup>6</sup> Bolt material will be same as Upper Material. However, if Table III bolt/nut option is chosen, seal bolt material will be the same.

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-32  
Issue 50  
Page 5 of 12

TABLE II - SEALS (continued)



		Diaphragm Diameter	Flange Size	Flange Pressure Rating Dependent on Customer Flange <sup>1</sup>		Selection	STR12D & 13D	STR14A	14G & 17G	
 <p>Pancake Seal</p> 		3.5"	3"	ANSI Class 150/300/600		___ GFA ___	•	•	•	
		Wetted Material	<b>Diaphragm</b>		<b>Body</b>		<b>Selection</b>			
			316L SS		316L SS		___ GA ___	•	•	•
			Hastelloy <sup>®</sup> C-276		316L SS		___ GB ___	•	•	•
			Hastelloy <sup>®</sup> C-276		Hastelloy <sup>®</sup> C-276		___ GC ___	•	•	•
			Monel 400 <sup>®</sup>		Monel 400 <sup>®</sup>		___ GE ___	•	•	•
			Tantalum		Tantalum <sup>7</sup>		___ GG ___	1	1	1
		Non-Wetted Material	No Selection		___ 0 ___		•	•	•	
		Bolts	No Selection		___ 0 ___		•	•	•	
		Calibration Rings	None		___ A ___		•	•	•	
			316L SS		___ B ___		5	5	5	
			Hastelloy <sup>®</sup> C-276		___ C ___		5	5	5	
	Monel 400 <sup>®</sup>		___ D ___		5	5	5			
	Flushing Connections and Plugs <sup>4</sup> (Metal plug material will be the same as Cal. Ring material, if metal plug is chosen - SS Plug for CS Lower)	None		___ 0 ___		•	•	•		
		One 1/4" with plastic plug		___ H ___		6	6	6		
		One 1/4" with metal plug		___ J ___		6	6	6		
		Two 1/4" with plastic plugs		___ M ___		6	6	6		
		Two 1/4" with metal plugs		___ N ___		6	6	6		
		One 1/2" with plastic plug		___ P ___		6	6	6		
		One 1/2" with metal plug		___ Q ___		6	6	6		
	Two 1/2" with plastic plugs		___ R ___		6	6	6			
	Two 1/2" with metal plugs		___ S ___		6	6	6			

Table II continued below

TABLE II - SEALS (continued)


		Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>	Selection	STR12D & 13D	STR14A	14G & 17G	
 <p>Chemical Tee "Taylor" Wedge</p>		3.5"	Taylor Wedge 5" O.D.	750 psi	___ HMO ___	v			
		Wetted Material	<b>Diaphragm</b>		<b>Body</b>		<b>Selection</b>		
			316L SS		316L SS		___ HA ___	•	
			Hastelloy <sup>®</sup> C-276		316L SS		___ HB ___	•	
			Hastelloy <sup>®</sup> C-276		Hastelloy <sup>®</sup> C-276		___ HC ___	•	
		Non-Wetted Material	No Selection		___ 0 ___		•		
	Bolts	No Selection		___ 0 ___		•			
	Styles	No Selection		___ 0 ___		•			
	No Selection	No Selection		___ 0 ___		•			

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.

<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

<sup>7</sup> Tantalum Body has Tantalum wetted parts and 316 SS non-wetted parts

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.



34-ST-16U-32  
 Issue 50  
 Page 6 of 12

TABLE II - SEALS (continued)


Diaphragm Diameter	Threaded Process Connection Size (NPT Female)	Pressure Rating		STR12D & 13D			STR14A		
		CS Bolts	304 SS Bolts	Selection			14G & 17G		
2.4"	1/2 NPT	2,500 psi	1,250 psi	--- JYG ---	t	4	•		
	3/4 NPT			--- JKG ---	t	4	•		
	1 NPT			--- JLG ---	t	4	•		
2.9"	1/2 NPT	2,500 psi	1,250 psi	--- KYG ---	•	•	•		
	3/4 NPT			--- KKG ---	•	•	•		
	1 NPT			--- KLG ---	•	•	•		
4.1"	1/2 NPT	1,500 psi	750 psi	--- LYG ---	•	•	•		
	3/4 NPT			--- LKG ---	•	•	•		
	1 NPT			--- LLG ---	•	•	•		
 Seal with Threaded Process Connection	Wetted Material	Diaphragm		Lower		Selection			
		316L SS	Carbon Steel	--- JA ---	•	•	•		
		316L SS	316L SS	--- JB ---	•	•	•		
		Hastelloy® C-276	316L SS	--- JC ---	•	•	•		
		Hastelloy® C-276	Hastelloy® C-276	--- JD ---	•	•	•		
		Monel 400®	Monel 400®	--- JE ---	•	•	•		
		Tantalum	316L SS	--- JF ---	1	1	1		
	Tantalum	Hastelloy® C-276	--- JG ---	1	1	1			
Non-Wetted Material (upper)	CS (Nickel Plated) Stainless Steel		--- A ---	•	•	•			
Bolts <sup>8</sup>	Carbon Steel		--- C ---	w	w	w			
	304 SS		--- D ---	•	•	•			
Flushing Connections and Plugs <sup>4</sup> (Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)	None		--- 0 ---	•	•	•			
	One 1/4" with plastic plug		--- H ---	•	•	•			
	One 1/4" with metal plug		--- J ---	•	•	•			
	Two 1/4" with plastic plugs		--- M ---	•	•	•			
	Two 1/4" with metal plugs		--- N ---	•	•	•			
	One 1/2" with plastic plug		--- P ---	11	11	11			
	One 1/2" with metal plug		--- Q ---	11	11	11			
Two 1/2" with plastic plugs		--- R ---	11	11	11				
Two 1/2" with metal plugs		--- S ---	11	11	11				
Gasket	Klinge® C-4401 (non-asbestos)		--- K ---	c	c	c			
	Grafoil®		--- G ---	•	•	•			
	Teflon®		--- T ---	c	c	c			
	Gylon® 3510		--- L ---	d	d	d			

Table II continued next page



<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

<sup>8</sup> If Table III Bolt/Nut option is chosen, Seal bolts will ship as same material, and MAWP may change.

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-32  
Issue 50  
Page 7 of 12

TABLE II - SEALS (continued)

		Diaphragm Diameter	Flange Size	Pressure Rating		Selection	STR12D & 13D	STR14A	14G & 17G	
 <p>Sanitary Seal<sup>9</sup></p>		1.9"	2"	Customer clamp rating or 600 psi, whichever is less		___ MD0 ___			24	
		2.4"	2-1/2"			___ NE0 ___	25		24	
		2.9"	3"			___ PF0 ___	24	24	24	
		4.1"	4"			___ QG0 ___	24	24	24	
		Wetted Material			Diaphragm	Body	Selection			
					316L SS	316L SS	___ N A ___	•	•	•
		Non-Wetted Material	No Selection		___ 0 ___		•	•	•	
		Bolts	No Selection		___ 0 ___		•	•	•	
	Styles	Tri-Clover Tri-Clamp <sup>®</sup>		___ 8 ___		•	•	•		
	Gasket	No Selection		___ 0 ___		•	•	•		
 <p>Saddle Seal</p>	Diaphragm Diameter	Size and Bolt Pattern	Seal Pressure Rating		Selection					
			C.S. Bolts	304 SS Bolts						
	2.4"	for 3" Pipe ≥ 4" pipe	1,500 psi	1,500 psi	___ RFK ___	t	4	•		
					___ RGK ___	t	4	•		
	2.4"	for 3" Pipe ≥ 4" pipe	1,250 psi	1,250 psi	___ RPK ___	t	4	•		
					___ RQK ___	t	4	•		
		Wetted Material	Diaphragm	Lower Housing	Selection					
			316L SS	Carbon Steel	___ RA ___		•	•	•	
			316L SS	316L SS	___ RB ___		•	•	•	
			Hastelloy <sup>®</sup> C-276	316L SS	___ RC ___		•	•	•	
			Hastelloy <sup>®</sup> C-276	Hastelloy <sup>®</sup> C-276	___ RD ___		•	•	•	
			316L SS	N/A-Body Only <sup>10</sup>	___ SB ___		•	•	•	
			Hastelloy <sup>®</sup> C-276	N/A-Body Only <sup>10</sup>	___ SC ___		•	•	•	
	Non-Wetted Material	Body	Bolts <sup>8,10</sup>	Selection						
		Carbon Steel	Carbon Steel	___ B ___		1	1	1		
		316L SS	304 SS	___ C ___		•	•	•		
	Bolts	No Selection		___ 0 ___		•	•	•		
	Styles	No Selection		___ 0 ___		•	•	•		
	Gasket	Klinger <sup>®</sup> C-4401 (non-asbestos)		___ K ___		•	•	•		
		Grafoil <sup>®</sup>		___ G ___		•	•	•		
		Teflon <sup>®</sup>		___ T ___		•	•	•		
		Gylon <sup>®</sup> 3510		___ L ___		•	•	•		

<sup>8</sup> If Table III Bolt/Nut option is chosen, Seal bolts will ship as same material, and MAWP may change.

<sup>9</sup> All sanitary seals have dairy grade 3A approval.

<sup>10</sup> Bolts are not included with "body only" selection.

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-32  
 Issue 50  
 Page 8 of 12

TABLE III - OPTIONS	Selection	STR14A		
		STR12D & 13D	14G & 17G	
<b>Communication Options (Must choose a communications option)</b>				
Analog only (can be configured using appropriate Honeywell DE tool)	AN	•	•	•
DE Protocol communications	DE	•	•	•
HART <sup>®</sup> 5.x Protocol compatible electronics	HC	•	•	•
HART <sup>®</sup> 6.x Protocol compatible electronics	H6	•	•	•
FOUNDATION <sup>™</sup> Fieldbus Communications	FF	r	r	r
<b>Indicating Meter Options</b>				
Analog Meter (0-100 Even 0-10 Square Root)	ME	•	•	•
Smart Meter	SM	•	•	•
Custom Configuration of Smart Meter	CI	f	f	f
Local Zero & Span	ZS	m	m	m
Local Zero	LZ	x	x	x
<b>Transmitter Housing &amp; Electronics Options</b>				
No housing conduit plugs or adaptors come standard with the ST 3000. For certain approval codes, you <b>must</b> select a certified conduit plug from below and it will come packaged in the box with your transmitter.				
316 SS <sup>5</sup> Electronics Housing - (with M20 Conduit Connections)	SH	n	n	n
316 SS <sup>5</sup> Electronics Housing - (with M20 to 1/2 NPT 316 SS Conduit Adapter for use with FM and CSA Approval codes)	A3	i	i	i
1/2 NPT Male to M20 Female 316 SS Certified Conduit Adapter (ATEX, CSA & IECEx)	A1	•	•	•
1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter (ATEX, CSA & IECEx)	A2	•	•	•
M20 Male to 1/2 NPT Female 316 SS Certified Conduit Adaptor (ATEX, CSA & IECEx)	A4	•	•	•
1/2 NPT Zinc-plated Certified Conduit Plug (ATEX, CSA & IECEx)	A5	•	•	•
1/2 NPT 316 SS Certified Conduit Plug (ATEX, CSA & IECEx)	A6	•	•	•
M20 316 SS Certified Conduit Plug (ATEX, CSA & IECEx)	A7	•	•	•
1/2 NPT Non-certified Conduit plug (Zinc-plated carbon steel, general use)	A8	•	•	•
NAMUR Failsafe Software	NE	15	15	15
SIL 2 - TÜV Certified transmitter (requires HC or H6 and WP options)	SL	14	14	14
Lightning Protection	LP	•	•	•
Custom Calibration and I.D. in Memory	CC	•	•	•
Transmitter Configuration - (non-Fieldbus)	TC	15	15	15
Transmitter Configuration - (Fieldbus)	FC	21	21	21
Write Protection (Delivered in the "enabled" position)	WP	•	•	•
Write Protection (Delivered in the "disabled" position)	WX	•	•	•
Stainless Steel Customer Wired-On Tag (4 lines, 26 characters per line, customer supplied information)	TG	•	•	•
Stainless Steel Customer Wired-On Tag (blank)	TB	•	•	•
<b>Meter Body Options (Seal bolt material depends on Transmitter bolt material)</b>				
A286 SS (NACE) Bolts and 304 SS (NACE) Nuts for Heads	CR	•	•	•
316 SS Bolts and 316 SS Nuts for Process Heads	SS	•	•	•
B7M Bolts and Nuts for Process Heads	B7	•	•	•
<b>Remote Seal Options</b>				
Gold Plated Seal Diaphragm (1 Seal)	G1	j	j	j
Gold Plated Seal Diaphragm (2 Seals)	G2	j	j	j
Teflon Coated Seal Diaphragm (1 Seal) - only for anti-sticking	N1	j	j	j
Teflon Coated Seal Diaphragms (2 Seals) - only for anti-sticking	N2	j	j	j
<b>Transmitter Mounting Bracket Options</b>				
Angle Mounting Bracket - Carbon Steel	MB	•	•	•
Marine Approved Angle Mounting Bracket - Carbon Steel	MX	•	•	•
Angle Mounting Bracket - 304 SS	SB	•	•	•
Marine Approved Angle Mounting Bracket - 304 SS	SX	•	•	•
Flat Mounting Bracket - Carbon Steel	FB	•	•	•
<b>Services/Certificates/Marine Type Approvals Options</b>				
Users Manual Paper Copy (Standard, HC/H6 or FF ships accordingly)	UM	•	•	•
Clean Transmitter for Oxygen or Chlorine Service with Certificate (50039190)	OX	h	h	h
Over-Pressure Leak Test with Certificate (F3392)	TP	•	•	•
Calibration Test Report and Certificate of Conformance (F3399)	F1	•	•	•
Certificate of Conformance (F3391)	F3	•	•	•
Certificate of Origin (F0195)	F5	•	•	•
SIL Certificate (SIL 2/3) (FC33337)	FE	22	22	22
NACE Certificate (Process-Wetted & Non-Process Wetted) (FC33339)	F7	o	o	•
NACE Certificate for all welded meter bodies only (F0198)	F8	16	•	•
NACE Certificate (Process-Wetted only) (FC33338)	FG	•	•	•
Material Traceability Certification per EN 10204 3.1 (FC33341)	FX	•	•	•
Marine Type Approvals (DNV, ABS, BV, KR & LR)	MT	2	2	2

<sup>5</sup> Supplied as 316 SS or as Grade CF8M, the casting equivalent of 316 SS.





34-ST-16U-32  
 Issue 50  
 Page 11 of 12

**RESTRICTIONS**

Restriction Letter	Available Only With		Not Available With	
	Table	Selection	Table	Selection
<b>b</b>		Select only one option from this group		
<b>c</b>			II	----- BF ----- ----- BG ----- ----- JF ----- ----- JG -----
<b>d</b>	II	----- BF ----- ----- BG ----- ----- BH ----- ----- JF ----- ----- JG -----		
<b>f</b>	III	SM		
<b>h</b>	I, II	_ 2 _ - 2 _ _ _ _ _		
<b>i</b>	III	1C or 2J		
<b>j</b>			II	----- AF ----- ----- BF ----- ----- BG ----- ----- BH ----- ----- GG ----- ----- JF ----- ----- JG -----
<b>m</b>			III	ME, FF
<b>n</b>			III	1C, 2J
<b>o</b>	III	CR		
<b>q</b>	II	0 ----- 2 ----- 4 -----		
<b>r</b>	III	FISCO/FNICO compliance available only with 1C	III	TC, ME or FISCO/FNICO compliance not available with 3C, 3N, 33, 3S, 2J, CA, Z2, ZD, ZA, 6D & 6S
<b>t</b>			I & II	2 _ _ - _ B _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ C _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ D _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ E _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ F _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ H _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ J _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ K _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ L _ _ _ _ _ _ _ _ _ _ 2 _ _ - _ M _ _ _ _ _ _ _ _ _ _

RESTRICTIONS (continued)

Restriction Letter	Available Only With		Not Available With	
	Table	Selection	Table	Selection
v	I	2 _ _		
w			II	_ _ _ _ _ JA _ _ _
x	III	FF, SM		
y			I	2
	II	2 _ _ _ _ _	III	MB, SB, FB
z	I	_ _ D		
1			III	F7
2	III	MX, SX	III	FB, MB, SB
3	I	5		
4	II	See Figure 23 in Specification		
		_ A _ _ _ _ _ , _ G _ _ _ _ _ , _ B _ _ _ _ _ , _ H _ _ _ _ _ , _ 2 _ _ _ _ _		
5			II	_ _ _ _ _ 0
6			II	_ _ _ _ _ A _
7			I	1 _ , 3 _
			III	CR
8			III	CC, G1, G2, N1, N2, 0X, TP, MT, TC, FC, F1
9	II	_ _ _ _ _ AA2 _ _ _ _ _ AB2		
10	II		II	_ _ _ _ _ T
			III	F7
11			II	_ _ _ _ _ JGG _ _ _ _ _ JKG _ _ _ _ _ JLG _ _ _ _ _ CAA _ _ _ _ _ CCA _ _ _ _ _ CCC
14	III	HC or H6 <u>and</u> WP	III	FF
15			III	FF
16	I	_ _ C		
21	III	FF		
22	III	SL		
24	III		I & II	2 _ _ - 2 _ _ _ _ _
25	II	_ A _ _ _ _ _ , _ G _ _ _ _ _ , _ 2 _ _ _ _ _		
26	III	This approval code <u>requires</u> the selection of a certified conduit plug: A5, A6 or A7		

FM Approvals<sup>SM</sup> is a service mark of FM Global  
 Hastelloy<sup>®</sup> is a registered trademark of Haynes International  
 Monel 400<sup>®</sup> is a registered trademark of Special Metals Corporation.  
 HART<sup>®</sup> is a registered trademark of HART Communication Foundation.  
 FOUNDATION<sup>TM</sup> Fieldbus is a registered trademark of Fieldbus Foundation.  
 Teflon<sup>®</sup> is a registered trademark of DuPont.  
 Neobee<sup>®</sup> is a registered trademark of Stepan Company.  
 Syltherm<sup>®</sup> 800 is a Trademark of Dow Corning Corporation  
 Klinger<sup>®</sup> C-4401 is a registered trademark of THERMOSEAL, INC  
 GRAFOIL<sup>®</sup> is a registered trademarks of GrafTech International Holdings Inc  
 Gylon<sup>®</sup> 3510 is registered trademark of Garlock Sealing Technologies  
 Tri-Clover Tri-Clamp<sup>®</sup> is a registered trademark of Alfa-Laval  
 DC<sup>®</sup> 200 and DC<sup>®</sup> 704 are registered trademarks of Dow Corning

Model Selection Guides are subject to change and are inserted into the specifications as guidance only. Prior to specifying or ordering a model check for the latest revision Model Selection Guides which are published at: <http://hpsweb.honeywell.com/Cultures/en-US/Products/Instrumentation/ProductModelSelectionGuides/default.htm>

**Model Selection Guide 34-ST-16-34 for ST 3000 Smart Transmitters (DP, GP) Remote Seals Series 900**



34-ST-16U-34  
Issue 47  
Page 1 of 11

**ST 3000 Smart Transmitter (DP & GP) Remote Seals Series 900**

**Model Selection Guide**



**Instructions**

- Select the desired Key Number. The arrow to the right marks the selection available.
- Make selections from each Table (I, II and IV), using the column below the proper arrow.
- Select as many Table III options as desired plus a communications option selection.
- A (\*) denotes unrestricted availability. A letter denotes restricted availability.
- Restrictions follow Table IV.

<b>Key Number</b>	<b>I</b>	<b>II</b>	<b>III (Optional)</b>	<b>IV</b>
_____	_____	_____	_____	XXXX

**KEY NUMBER**

Description	Selection	Avail.
<b>0-25" to 0-2,700" H<sub>2</sub>O / 0-62.2 to 0-7,000 mbar</b> Body Rating*: 750 psi (51.7 bar) Compound Characterized	STR93D	↓
<b>0-5 to 0-500 psig / 0-0.35 to 0-35 bar</b> Body Rating*: 500 psi (35 bar)	STR94G	↓

\* Remote seal system pressure rating is body rating or seal rating, whichever is less.

**Important Note:** Base STR models no longer include a default communications option. All units now require the selection of a communication option from Table III (AN, DE, HC, H6 or FF).

**TABLE I - METER BODY**

	Description	Selection		
<b>Number of Seals</b>	1 Remote Seal ( <i>High Side</i> )	1 __	•	•
	2 Remote Seals	2 __	•	
	1 Remote Seal ( <i>Low Side</i> )	3 __	•	
	Value Added Model ( <i>VAM unit</i> )	5 __	8	8
<b>Fill Fluid (<i>Meter Body</i>)</b>	DC <sup>®</sup> 200 Silicone	_ 1 _	•	•
	CTFE	_ 2 _	q	q
<b>Construction</b>	<b>Non-Wetted Material</b>			
<b>In-Line Gauge</b>	316 SS	__ A		•
	316 SS for Close-Couple	__ D		y
<b>Dual Head DP</b>	316 SS Heads	__ A	•	
	316 SS Heads for Close-Couple connection	__ D	y	
	316 SS with all-welded meter body	__ C		7

See Specification Sheet 34-ST-03-57 for figures on construction.



**In-Line Gauge**



**Dual Head DP**



**All Welded**



**34-ST-16U-34**  
**Issue 47**  
**Page 2 of 11**

**TABLE II - SEALS**

Format for Seal Selection:					Availability		
Specify 12 characters					STR9xx		
<b>Note:</b> The first 3 characters are common to all seals. When selecting required seal, you must specify only the 9 selections within the required seal.							
					Selection	3D	4G
Secondary Fill	No Fill Fluid				0	3	3
	Silicone DC <sup>®</sup> 200				1	•	•
	CTFE				2	•	•
	Silicone DC <sup>®</sup> 704				3	•	•
	Neobee <sup>®</sup> M20 <sup>2</sup>				4	•	•
	Syltherm <sup>®</sup> 800 <sup>3</sup>				5	•	•
 Connection of Remote Seal to Meter Body	No Capillary, No Nipple				_ 0	3	3
	Capillary Length	5 feet	1.5 m	SS Armor	_ A	•	•
		10 feet	3.0 m		_ B	•	•
		15 feet	4.5 m		_ C	•	•
		20 feet	6.1 m		_ D	•	•
		25 feet	7.5 m		_ E	•	•
		35 feet	10.7 m		_ F	•	•
	5 feet	1.5 m	PVC Coated SS Armor	_ G	•	•	
		10 feet		3.0 m	_ H	•	•
		15 feet		4.5 m	_ J	•	•
		20 feet		6.1 m	_ K	•	•
25 feet		7.5 m		_ L	•	•	
35 feet		10.7 m		_ M	•	•	
2 inch long SS nipple close-coupled				_ 2	z	z	
No Selection					_ 0	•	•
No Seal Attached to Core Transmitter					_ 000000000	3	3
 Flush Flanged Seal	Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>		Selection		
	3.5"	3"	ANSI Class 150		_ AFA	•	•
		80mm	ANSI Class 300		_ AFC	•	•
			DIN DN80-PN40		_ AFM	•	•
	Wetted Material		Diaphragm	Upper Insert	Selection		
			316L SS	316L SS	_ AA	•	•
			Hastelloy <sup>®</sup> C-276	316L SS	_ AB	•	•
			Hastelloy <sup>®</sup> C-276	Hastelloy <sup>®</sup> C-276	_ AC	•	•
			Monel 400 <sup>®</sup>	Monel 400 <sup>®</sup>	_ AE	•	•
			Tantalum <sup>5</sup>		_ AF	1	1
Flange Material		CS (Nickel Plated)		_ 1	•	•	
		316L SS		_ 2	•	•	
Seal-Capillary Connection		Center Seal		_ 1	•	•	
		Side Seal		_ 2	9	9	
Calibration Rings		None		_ A	•	•	
		316L SS		_ B	5	5	
		Hastelloy <sup>®</sup> C-276		_ C	5	5	
		Monel 400 <sup>®</sup>		_ D	5	5	

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.

<sup>2</sup> Limited vacuum availability.

<sup>3</sup> Minimum static pressure requirement. No vacuum allowed. See Specifications Figure 15.

<sup>5</sup> Tantalum Upper insert has Tantalum wetted parts and 316 SS or CS non-wetted parts

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE II - SEALS (continued)


		Availability	
		STR9xx	
			3D 4G
		Description	Selection
 <p>Flush Flanged Seal</p> <p>Flushing Connections and Plugs<sup>4</sup> <i>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</i></p>	None	0	• •
	One 1/4" with plastic plug	H	6 6
	One 1/4" with metal plug	J	6 6
	Two 1/4" with plastic plugs	M	6 6
	Two 1/4" with metal plugs	N	6 6
	One 1/2" with plastic plug	P	6 6
	One 1/2" with metal plug	Q	6 6
	Two 1/2" with plastic plugs	R	6 6
	Two 1/2" with metal plugs	S	6 6

Table II continued below


		Availability			
		STR9xx			
			3D 4G		
		Diaphragm Diameter	Flange Size		
		Flange Pressure Rating <sup>1</sup>	Const. - See Spec. Figure 34-ST-03-57		
		Selection			
 <p>Flush Flanged Seal with Lower</p>	2.4"	1" ANSI 150	22	--- BCA ---	• •
		1" ANSI 300	22	--- BCC ---	• •
		1-1/2" ANSI 150	22	--- BGA ---	• •
		1-1/2" ANSI 300	22	--- BGC ---	• •
		2" ANSI 150	22	--- BDA ---	• •
		2" ANSI 300	22	--- BDC ---	• •
	2.9"	3" ANSI 150	22	--- BFA ---	• •
		3" ANSI 300	22	--- BFC ---	• •
		1/2" ANSI 150	23	--- CAA ---	• •
		1" ANSI 150	23	--- CCA ---	• •
		1" ANSI 300	23	--- CCC ---	• •
		1-1/2" ANSI 150	22	--- CGA ---	• •
	4.1"	1-1/2" ANSI 300	22	--- CGC ---	• •
		2" ANSI 150	22	--- CDA ---	• •
		2" ANSI 300	22	--- CDC ---	• •
		1/2" ANSI 150	23	--- DAA ---	• •
		1" ANSI 150	23	--- DCA ---	• •
		1" ANSI 300	23	--- DCC ---	• •
		1-1/2" ANSI 150	23	--- DGA ---	• •
		1-1/2" ANSI 300	23	--- DGC ---	• •
		2" ANSI 150	23	--- DDA ---	• •
		2" ANSI 300	22	--- DDC ---	• •
		3" ANSI 150	22	--- DFA ---	• •
		3" ANSI 300	22	--- DFC ---	• •

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.

<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-34  
Issue 47  
Page 4 of 11

Availability  
STR9xx      ↓      ↓  
                         3D    4G

TABLE II - SEALS (continued)



 <p>Flush Flanged Seal with Lower (continued)</p>	Wetted Material		<b>Diaphragm</b>	<b>Lower</b>	<b>Selection</b>	<b>3D</b>	<b>4G</b>
			316L SS	316L SS	----- BA -----	•	•
			Hastelloy® C-276	316L SS	----- BB -----	•	•
			Hastelloy® C-276	Hastelloy® C-276	----- BC -----	•	•
			Monel 400®	Monel 400®	----- BE -----	•	•
			Tantalum	316L SS	----- BF -----	1	1
			Tantalum	Hastelloy® C-276	----- BG -----	1	1
	Tantalum	Tantalum Clad	----- BH -----	10	10		
	Non-Wetted Material (upper, upper insert)		<b>Upper</b>	<b>Upper Insert</b>	<b>Selection</b>		
			316L SS	316L SS	----- 4 -----	•	•
Bolts <sup>6</sup>		No Selection		----- 0 -----	•	•	
		Flushing Connections and Plugs <sup>4</sup>		----- 0 -----	•	•	
<p>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</p>		None		----- 0 -----	•	•	
		One 1/4" with plastic plug		----- H -----	•	•	
		One 1/4" with metal plug		----- J -----	•	•	
		Two 1/4" with plastic plugs		----- M -----	•	•	
		Two 1/4" with metal plugs		----- N -----	•	•	
		One 1/2" with plastic plug		----- P -----	•	•	
		One 1/2" with metal plug		----- Q -----	•	•	
		Two 1/2" with plastic plugs		----- R -----	•	•	
Two 1/2" with metal plugs		----- S -----	•	•			
Gasket		Klinger® C-4401 (non-asbestos)		----- K -----	c	c	
		Grafoil®		----- G -----	•	•	
		Teflon®		----- T -----	c	c	
		Gylon® 3510		----- L -----	d	d	
 <p>Flange Seal with Extended Diaphragm</p>	<b>Diaphragm Diameter</b>	<b>Flange Size</b>	<b>Flange Pressure Rating<sup>1</sup></b>		<b>Selection</b>		
	2.8"	3" (2.8" OD extension)	ANSI Class 150		----- EFA -----	•	•
			ANSI Class 300		----- EFC -----	•	•
			DIN DN80-PN40		----- EFM -----	•	•
	3.5"	4" (3.70" OD extension)	ANSI Class 150		----- FGA -----	•	•
			ANSI Class 300		----- FGC -----	•	•
			DIN DN100-PN40		----- FGP -----	•	•
	Wetted Material		<b>Diaphragm</b>	<b>Ext. Tube</b>	<b>Selection</b>		
			316L SS	316L SS	----- EA -----	•	•
			Hastelloy® C-276	316L SS	----- EB -----	•	•
Flange Material		CS (Nickel Plated)		----- 7 -----	•	•	
		316L SS		----- 8 -----	•	•	
Bolts		No Selection		----- 0 -----	•	•	
Extension Length		2"		----- 2 -----	•	•	
		4"		----- 4 -----	•	•	
		6"		----- 6 -----	•	•	
No Selection		No Selection		----- 0 -----	•	•	

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.

<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

<sup>6</sup> Bolt material will be same as Upper Material. However, if Table III bolt/nut option is chosen, seal bolt material will be the same.

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

Availability  
STR9xx ↓ ↓  
3D 4G

**TABLE II - SEALS (continued)**



	Diaphragm Diameter	Flange Size	Flange Pressure Rating Dependent on Customer Flange <sup>1</sup>		Selection	3D	4G	
			Diaphragm	Body				Selection
 Pancake Seal 	3.5"	3"	ANSI Class 150/300/600		___ GFA ___	•	•	
	Wetted Material			316L SS	316L SS	___ GA ___	•	•
				Hastelloy <sup>®</sup> C-276	316L SS	___ GB ___	•	•
				Hastelloy <sup>®</sup> C-276	Hastelloy <sup>®</sup> C-276	___ GC ___	•	•
				Monel 400 <sup>®</sup>	Monel 400 <sup>®</sup>	___ GE ___	•	•
				Tantalum	Tantalum <sup>7</sup>	___ GG ___	1	1
	Non-Wetted Materials		No Selection		___ 0 ___	•	•	
	No Selection		No Selection		___ 0 ___	•	•	
	Calibration Rings		None		___ A ___	•	•	
			316L SS		___ B ___	5	5	
		Hastelloy <sup>®</sup> C-276		___ C ___	5	5		
		Monel 400 <sup>®</sup>		___ D ___	5	5		
Flushing Connections and Plugs <sup>4</sup>		None		___ 0 ___	•	•		
		One 1/4" with plastic plug		___ H ___	6	6		
		One 1/4" with metal plug		___ J ___	6	6		
		Two 1/4" with plastic plugs		___ M ___	6	6		
		Two 1/4" with metal plugs		___ N ___	6	6		
		One 1/2" with plastic plug		___ P ___	6	6		
		One 1/2" with metal plug		___ Q ___	6	6		
		Two 1/2" with plastic plugs		___ R ___	6	6		
		Two 1/2" with metal plugs		___ S ___	6	6		

Table II continued below

Availability  
STR9xx ↓ ↓  
3D 4G

**TABLE II - SEALS (continued)**


	Diaphragm Diameter	Flange Size	Flange Pressure Rating <sup>1</sup>		Selection	3D	4G	
			Diaphragm	Body				Selection
 Chemical Tee "Taylor" Wedge	3.5"	Taylor Wedge 5" O.D.	750 psi		___ HM0 ___	v		
	Wetted Material			316L SS	316L SS	___ HA ___	•	
				Hastelloy <sup>®</sup> C-276	316L SS	___ HB ___	•	
				Hastelloy <sup>®</sup> C-276	Hastelloy <sup>®</sup> C-276	___ HC ___	•	
	Non-Wetted Material		No Selection		___ 0 ___	•		
	Bolts		No Selection		___ 0 ___	•		
	Styles		No Selection		___ 0 ___	•		
No Selection		No Selection		___ 0 ___	•			

Table II continued next page

<sup>1</sup> Standard facing 125-250 AARH RF (raised face) serrated surface finish.


<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

<sup>7</sup> Tantalum Body has Tantalum wetted parts and 316 SS non-wetted parts

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-34  
Issue 47  
Page 6 of 11

TABLE II - SEALS (continued)



	Diaphragm Diameter	Threaded Process Connection Size (NPT Female)	Seal Pressure Rating *		Selection	Availability	
			C.S. Bolts	304 SS Bolts		3D	4G
 <p>Seal with Threaded Process Connection</p>	2.4"	1/2 NPT	2,500 psi	1,250 psi	--- J J G ---	•	•
		3/4 NPT			--- J K G ---	•	•
		1 NPT			--- J L G ---	•	•
	2.9"	1/2 NPT	2,500 psi	1,250 psi	--- K J G ---	•	•
		3/4 NPT			--- K K G ---	•	•
		1 NPT			--- K L G ---	•	•
	4.1"	1/2 NPT	1,500 psi	750 psi	--- L J G ---	•	•
		3/4 NPT			--- L K G ---	•	•
		1 NPT			--- L L G ---	•	•
	Wetted Material	Diaphragm	Lower	Selection			
		316L SS	Carbon Steel	--- J A ---	•	•	
		316L SS	316L SS	--- J B ---	•	•	
		Hastelloy® C-276	316L SS	--- J C ---	•	•	
		Hastelloy® C-276	Hastelloy® C-276	--- J D ---	•	•	
		Monel 400®	Monel 400®	--- J E ---	•	•	
Tantalum		316L SS	--- J F ---	1	1		
Tantalum	Hastelloy® C-276	--- J G ---	1	1			
Non-Wetted Material (upper)	CS (Nickel Plated) Stainless Steel		--- A --- --- C ---	• w	• w		
Bolts <sup>8</sup>	Carbon Steel 304 SS		--- C --- --- D ---	1 •	1 •		
Flushing Connections and Plugs <sup>4</sup>	None		--- 0 ---	•	•		
<i>Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)</i>	One 1/4" with plastic plug		--- H ---	•	•		
	One 1/4" with metal plug		--- J ---	•	•		
	Two 1/4" with plastic plugs		--- M ---	•	•		
	Two 1/4" with metal plugs		--- N ---	•	•		
	One 1/2" with plastic plug		--- P ---	11	11		
	One 1/2" with metal plug		--- Q ---	11	11		
Two 1/2" with plastic plugs		--- R ---	11	11			
Two 1/2" with metal plugs		--- S ---	11	11			
Gasket	Klinger® C-4401 (non-asbestos)		--- K ---	c	c		
	Grafoil®		--- G ---	•	•		
	Teflon®		--- T ---	c	c		
	Gylon® 3510		--- L ---	d	d		

<sup>4</sup> Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

<sup>8</sup> If Table III Bolt/Nut option is chosen, Seal bolts will ship as same material, and MAWP may change.

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE II - SEALS (continued)

						Availability		
						STR9xx		
		Diaphragm Diameter	Flange Size	Pressure Rating		Selection		
						3D	4G	
 <p>Sanitary Seal <sup>9</sup></p>	1.9"	2"	Customer clamp rating or 600 psi, whichever is less		___ MD0 ___	25	24	
	2.4"	2-1/2"			___ NE0 ___	24	24	
	2.9"	3"			___ PF0 ___	24	24	
	4.1"	4"			___ QG0 ___	24	24	
	Wetted Material		Diaphragm		Body	Selection		
			316L SS		316L SS	___ N A ___	•	•
	Non-Wetted Material		No Selection		___ 0 ___		•	•
Bolts		No Selection		___ 0 ___		•	•	
Styles		Tri-Clover Tri-Clamp <sup>®</sup>		___ 8 ___		•	•	
Gasket		No Selection		___ 0 ___		•	•	
 <p>Saddle Seal</p>	Diaphragm Diameter	Size and Bolt Pattern	Seal Pressure Rating * *		Selection			
			C.S. Bolts	304 SS Bolts				
	2.4" 8-Bolt Design	for 3" Pipe ≥ 4" pipe	1,500 psi	1,500 psi	___ RFK ___	•	•	
					___ RGK ___	•	•	
	2.4" 6-Bolt Design	for 3" Pipe ≥ 4" pipe	1,250 psi	1,250 psi	___ RPK ___	•	•	
					___ RQK ___	•	•	
	Wetted Material		Diaphragm		Lower Housing	Selection		
			316L SS		Carbon Steel	___ RA ___	•	•
			316L SS		316L SS	___ RB ___	•	•
			Hastelloy <sup>®</sup> C-276		316L SS	___ RC ___	•	•
		Hastelloy <sup>®</sup> C-276		Hastelloy <sup>®</sup> C-276	___ RD ___	•	•	
		316L SS		N/A-Body Only <sup>10</sup>	___ SB ___	•	•	
		Hastelloy <sup>®</sup> C-276		N/A-Body Only <sup>10</sup>	___ SC ___	•	•	
Non-Wetted Material		Body		Bolts <sup>8, 10</sup>	Selection			
		Carbon Steel		Carbon Steel	___ B ___	1	1	
		316L SS		304 SS	___ C ___	•	•	
No Selection		No Selection		___ 0 ___		•	•	
Styles		No Selection		___ 0 ___		•	•	
Gasket		Klinger <sup>®</sup> C-4401 (non-asbestos)		___ K ___		•	•	
		Grafoil <sup>®</sup>		___ G ___		•	•	
		Teflon <sup>®</sup>		___ T ___		•	•	
		Gylon <sup>®</sup> 3510		___ L ___		•	•	

<sup>8</sup> If Table III Bolt/Nut option is chosen, Seal bolts will ship as same material, and MAWP may change.

<sup>9</sup> All sanitary seals have dairy grade 3A approval.

<sup>10</sup> Bolts are not included with "body only" selection.

**Note:** Remote seal system pressure rating is body rating or seal rating, whichever is less.

34-ST-16U-34  
 Issue 47  
 Page 8 of 11

TABLE III - OPTIONS	Selection	Availability	
		3D	4G
<b>Communication Options</b> (Must choose a communications option)			
Analog only (can be configured using appropriate Honeywell DE tool)	AN	•	•
DE Protocol communications	DE	•	•
HART® 5.x Protocol compatible electronics	HC	•	•
HART® 6.x Protocol compatible electronics	H6	•	•
FOUNDATION™ Fieldbus Communications	FF	r	r
<b>Indicating Meter Options</b>			
Analog Meter (0-100 Even 0-10 Square Root)	ME	•	•
Smart Meter	SM	•	•
Custom Configuration of Smart Meter	CI	m	m
Local Zero	LZ	x	x
Local Zero and Span	ZS	s	s
<b>Transmitter Housing &amp; Electronics Options</b>			
No housing conduit plugs or adaptors come standard with the ST 3000. For certain approval codes, you <b>must</b> select a certified conduit plug from below and it will come packaged in the box with your transmitter.			
316 SS <sup>5</sup> Electronics Housing - (with M20 Conduit Connections)	SH	n	n
316 SS <sup>5</sup> Electronics Housing - (with M20 to 1/2 NPT 316 SS Conduit Adapter for use with FM and CSA Approval codes)	A3	i	i
1/2 NPT Male to M20 Female 316 SS Certified Conduit Adapter (ATEX, CSA & IECEx)	A1	•	•
1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter (ATEX, CSA & IECEx)	A2	•	•
M20 Male to 1/2 NPT Female 316 SS Certified Conduit Adaptor (ATEX, CSA & IECEx)	A4	•	•
1/2 NPT Zinc-plated Certified Conduit Plug (ATEX, CSA & IECEx)	A5	•	•
1/2 NPT 316 SS Certified Conduit Plug (ATEX, CSA & IECEx)	A6	•	•
M20 316 SS Certified Conduit Plug (ATEX, CSA & IECEx)	A7	•	•
1/2 NPT Non-certified Conduit plug (Zinc-plated carbon steel, general use)	A8	•	•
NAMUR Failsafe Software	NE	15	15
SIL 2 - TÜV Certified transmitter (requires HC or H6 and WP options)	SL	14	14
Lightning Protection	LP	•	•
Custom Calibration and I.D. in Memory	CC	•	•
Transmitter Configuration - (non-Fieldbus)	TC	15	15
Transmitter Configuration - (Fieldbus)	FC	21	21
Write Protection (Delivered in the "enabled" position)	WP	•	•
Write Protection (Delivered in the "disabled" position)	WX	•	•
Stainless Steel Customer Wired-On Tag (4 lines, 26 characters per line, customer supplied information)	TG	•	•
Stainless Steel Customer Wired-On Tag (blank)	TB	•	•
<b>Meter Body Options</b> (Carbon Steel standard)			
A286 SS (NACE) Bolts and 304 SS (NACE) Nuts for Heads	CR	•	•
316 SS Bolts and 316 SS Nuts for Process Heads	SS	•	•
B7M Bolts and Nuts for Process Heads	B7	•	•
<b>Remote Seal Options</b>			
Gold Plated Seal Diaphragm (1 Seal)	G1	j	j
Gold Plated Seal Diaphragm (2 Seals)	G2	j	j
Teflon Coated Seal Diaphragm (1 Seal) - only for anti-sticking	N1	j	j
Teflon Coated Seal Diaphragms(2 Seals) - only for anti-sticking	N2	j	j
<b>Transmitter Mounting Bracket Options</b>			
Angle Mounting Bracket - Carbon Steel	MB	•	•
Marine Approved Angle Mounting Bracket - Carbon Steel	MX	•	•
Angle Mounting Bracket - 304 SS	SB	•	•
Marine Approved Angle Mounting Bracket - 304 SS	SX	•	•
Flat Mounting Bracket - Carbon Steel	FB	•	•
<b>Services/Certificates Options</b>			
Users Manual Paper Copy (Standard, HC/H6 or FF ships accordingly)	UM	•	•
Clean Transmitter & Seals for Oxygen or Chlorine Service with Certificate	OX	h	h
Over-Pressure Leak Test with Certificate (F3392)	TP	•	•
Calibration Test Report and Certificate of Conformance (F3399)	F1	•	•
Certificate of Conformance (F3391)	F3	•	•
Certificate of Origin (F0195)	F5	•	•
SIL Certificate (SIL 2/3) (FC33337)	FE	22	22
NACE Certificate (Process-Wetted & Non-Process Wetted) (FC33339)	F7	o	•
NACE Certificate for welded meter bodies only (F0198)	F8	16	•
NACE Certificate (Process-Wetted) (FC33338)	FG	•	•
Material Traceability Certification per EN 10204 3.1 (FC33341)	FX	•	•
Marine Type Approvals (DNV, ABS, BV, KR & LR)	MT	2	2

Table III continued next page

<sup>5</sup> Supplied as 316 SS or as Grade CF8M, the casting equivalent of 316 SS.













TABLE III - OPTIONS (continued)			STR9xx Selection	3D	4G
<b>Warranty Options</b>					
Additional Warranty - 1 year			W1	•	•
Additional Warranty - 2 years			W2	•	•
Additional Warranty - 3 years			W3	•	•
Additional Warranty - 4 years			W4	•	•
Approval Body	Approval Type	Location or Classification	Selection	3D	4G
No hazardous location approvals			9X	•	•
FM Approvals <sup>SM</sup>	Explosion Proof	Class I, Div. 1, Groups A,B,C,D	1C	•	•
	Dust-Ignitionproof	Class II, III Div. 1, Groups E,F,G			
	Non-Incendive	Class I, Div. 2, Groups A,B,C,D			
	Intrinsically Safe	Class I, II, III, Div. 1, Groups A,B,C,D,E,F,G			
ATEX <sup>10</sup> (LCIE)	Intrinsically Safe, Zone 0	 <b>Ex ia IIC</b> T4 (Ta = -50°C to +93°C); T5 (Ta = -50°C to +85°C); T6 (Ta = -50°C to +70°C) Enclosure IP 66/67	3S	•	•
	Intrinsically Safe, Zone 1	 <b>Ex ia IIC</b> T4 (Ta = -50°C to +93°C); T5 (Ta = -50°C to +85°C); T6 (Ta = -50°C to +70°C) Enclosure IP 66/67			
	Dust-tight Enclosure, Zone 0	 <b>Ex tD A20 IP6X</b> T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C)) Enclosure IP 66/67	33	26	26
	Flameproof and Dust-tight Enclosure, Zone 1	 <b>Ex d IIC</b> T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C) Supply 11- 42Vdc <b>Ex tD A21 IP6X</b> T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C) Enclosure IP 66/67			
	Non-Sparking, Zone 2	 <b>Ex nA, IIC</b> T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C); Zone 2 Supply < 42Vdc, 23mA <b>Ex tD A22 IP6X</b> T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C) (Honeywell). Enclosure IP 66/67			
	Multiple Marking <sup>11</sup> Int. Safe, Zone 0/1 and Dust-tight Enclosure, or Flameproof, Zone 1 and and Dust-tight Enclosure, or Non-Sparking, Zone 2	 <b>Ex ia IIC</b> T4 (Ta = -50°C to +93°C); T5 (Ta = -50°C to +85°C); T6 (Ta = -50°C to +70°C); Ui = 30V; Ii = 100mA <b>Ex tD A20 IP6X</b> T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C)	3C	26	26
 <b>Ex d IIC</b> T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C) Supply 11- 42Vdc <b>Ex tD A21 IP6X</b> T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C)					
 <b>Ex nA, IIC</b> T5 (Ta = -40°C to +93°C), T6 (Ta = -40°C to +78°C); Zone 2 Supply < 42Vdc, 23mA <b>Ex tD A22 IP6X</b> T95°C (at Ta = 93°C) or T80°C (at Ta = 78°C) (Honeywell) Enclosure IP 66/67					

Table III Approvals continued next page

STR9xx

TABLE III - Approvals Options (continued)				3D	4G
Approval Body	Approval Type	Location or Classification	Selection		
Canadian Standards Association (CSA)	Explosion Proof	Class I, Div. 1, Groups B,C,D	2J	26	26
	Dust-Ignitionproof	Class II, III, Div. 1, Groups E,F,G			
	Intrinsically Safe	Class I, II, III, Div. 1, Groups A,B,C,D,E,F,G			
IECEx	Flameproof, Zone 1	<b>Ex d IIC</b> ; T5 (Ta = -40 to +93°C), T6 (Ta = -40 to +78°C)	CA	26	26
	Intrinsically Safe, Zone 0/1	<b>Ex ia IIC</b> ; T3, T4, T5, T6 See Spec for detailed temperature codes by Communications option			
SAEx (South Africa)	Intrinsically Safe, Zone 0/1	<b>Ex ia IIC</b> T4, T5, T6	Z2	•	•
	Flameproof, Zone 1	<b>Ex d IIC</b> T5, T6 Enclosure IP 66/67	ZD	•	•
	Multiple Marking <sup>11</sup> Int. Safe, Zone 0/1, or Flameproof, Zone 1	<b>Ex ia IIC</b> T4, T5, T6 <b>Ex d IIC</b> T5, T6 Enclosure IP 66/67	ZA	•	•
CERTUSP INMETRO (Brazil)	Flameproof, Zone 1	<b>BR-Ex d IIC</b> T5, T6	6D	•	•
	Intrinsically Safe, Zone 0/1	<b>BR-Ex ia IIC</b> ; T4, T5, T6 (See CERTUSP certificate for detailed temperature codes by Communications option)	6S	•	•

<sup>10</sup> See ATEX installation requirements in the ST 3000 User's Manual

<sup>11</sup> The user must determine the type of protection required for installation of the equipment. The user shall then check the box [x] adjacent to the type of protection used on the equipment certification nameplate. Once a type of protection has been checked on the nameplate, subsequently the equipment shall not be reinstalled using any of the other certification types.

TABLE IV		Selection		
Factory Identification		X X X X	•	•

**RESTRICTIONS**

Restriction Letter	Available Only With		Not Available With	
	Table	Selection	Table	Selection
<b>b</b>		Select only one option from this group		
<b>c</b>			II	----- BF ----- ----- BG ----- ----- BH ----- ----- JF ----- ----- JG -----
<b>d</b>	II	----- BF ----- ----- BG ----- ----- JF ----- ----- JG -----		
<b>h</b>	I, II	__ 2 __ - 2		
<b>i</b>	III	1C or 2J		
<b>j</b>			II	----- AF ----- ----- BF ----- ----- BG ----- ----- BH ----- ----- GG ----- ----- JF ----- ----- JG -----
<b>m</b>	III	SM		
<b>n</b>			III	1C, 2J
<b>o</b>	III	CR		
<b>q</b>	II	0 ----- 2 ----- 4 -----		
<b>r</b>	III	FISCO/FNICO compliance available only with 1C	III	TC, ME or FISCO/FNICO compliance not available with 3C, 3N, 33, 3S, 2J, CA, Z2, ZD, ZA, 6D & 6S
<b>s</b>			III	FF, ME
<b>v</b>	I	2 __		
<b>w</b>			II	----- JA -----
<b>x</b>	III	FF, SM		

Restrictions continued next page

**RESTRICTIONS - (continued)**

Restriction Letter	Available Only With		Not Available With	
	Table	Selection	Table	Selection
y			I	2
			III	MB, SB, FB
	II	_ 2 _ _ _ _ _		
z	I	_ _ D		
1			III	F7
2	III	MX, SX	III	FB, MB, SB
3	I	5 _ _		
5			II	_ _ _ _ _ 0
6			II	_ _ _ _ _ A _
7			I	1 _ , 3
			III	CR
8			III	CC, G1, G2, N1, N2, 0X, TP, MT, F1, TC, FC
9	II	_ _ _ _ AA2 _ _		
		_ _ _ _ AB2 _ _		
10	II	_ _ _ _ _ 0 _	II	_ _ _ _ _ T
			III	F7
11			II	_ _ _ _ JG _ _
				_ _ _ _ JKG _ _
				_ _ _ _ JLG _ _
				_ _ _ _ CAA _ _
				_ _ _ _ CCA _ _
				_ _ _ _ CCC _ _
14	III	HC or H6 and WP	III	FF
15			III	FF
16	I	_ _ C		
21	III	FF		
22	III	SL		
24	III		I & II	2 _ _ - _ 2 _ _ _ _ _
25	II	_ A _ _ _ _ _ ,	II	
		_ G _ _ _ _ _ ,		
		_ 2 _ _ _ _ _		
26	III	This approval code <u>requires</u> the selection of a certified conduit plug: A5, A6 or A7		

FM Approvals<sup>SM</sup> is a service mark of FM Global  
 Hastelloy<sup>®</sup> is a registered trademark of Haynes International  
 Monel 400<sup>®</sup> is a registered trademark of Special Metals Corporation.  
 HART<sup>®</sup> is a registered trademark of HART Communication Foundation.  
 FOUNDATION<sup>TM</sup> Fieldbus is a registered trademark of Fieldbus Foundation.  
 Teflon<sup>®</sup> is a registered trademark of DuPont.  
 Neobee<sup>®</sup> is a registered trademark of Stepan Company.  
 Syltherm<sup>®</sup> 800 is a Trademark of Dow Corning Corporation  
 Klingsil<sup>®</sup> C-4401 is a registered trademark of THERMOSEAL, INC  
 GRAFOIL<sup>®</sup> is a registered trademarks of Graftech International Holdings Inc  
 Gylon<sup>®</sup> 3510 is registered trademark of Garlock Sealing Technologies  
 Tri-Clover Tri-Clamp<sup>®</sup> is a registered trademark of Alfa-Laval  
 DC<sup>®</sup> 200 and DC<sup>®</sup> 704 are registered trademarks of Dow Corning

*Specifications are subject to change without notice.*

**For More Information**

Learn more about how Honeywell's ST 3000 Smart Pressure Transmitters can increase performance, reduce downtime and decrease configuration costs, visit our website [www.honeywell.com/ps](http://www.honeywell.com/ps) or contact your Honeywell account manager.

**Honeywell Process Solutions**

1860 West Rose Garden Lane  
Phoenix, Arizona 85027  
1-800-423-9883 or 1-800-343-0228

[www.honeywell.com/ps/hfs](http://www.honeywell.com/ps/hfs)

34-ST-03-26  
August 2011  
© 2011 Honeywell International Inc.

The Honeywell logo is displayed in a bold, red, sans-serif font.